




2-Methylnaphthalene Detections in CAMU Unit 1 Leak Detection Samples
2007 - 2017

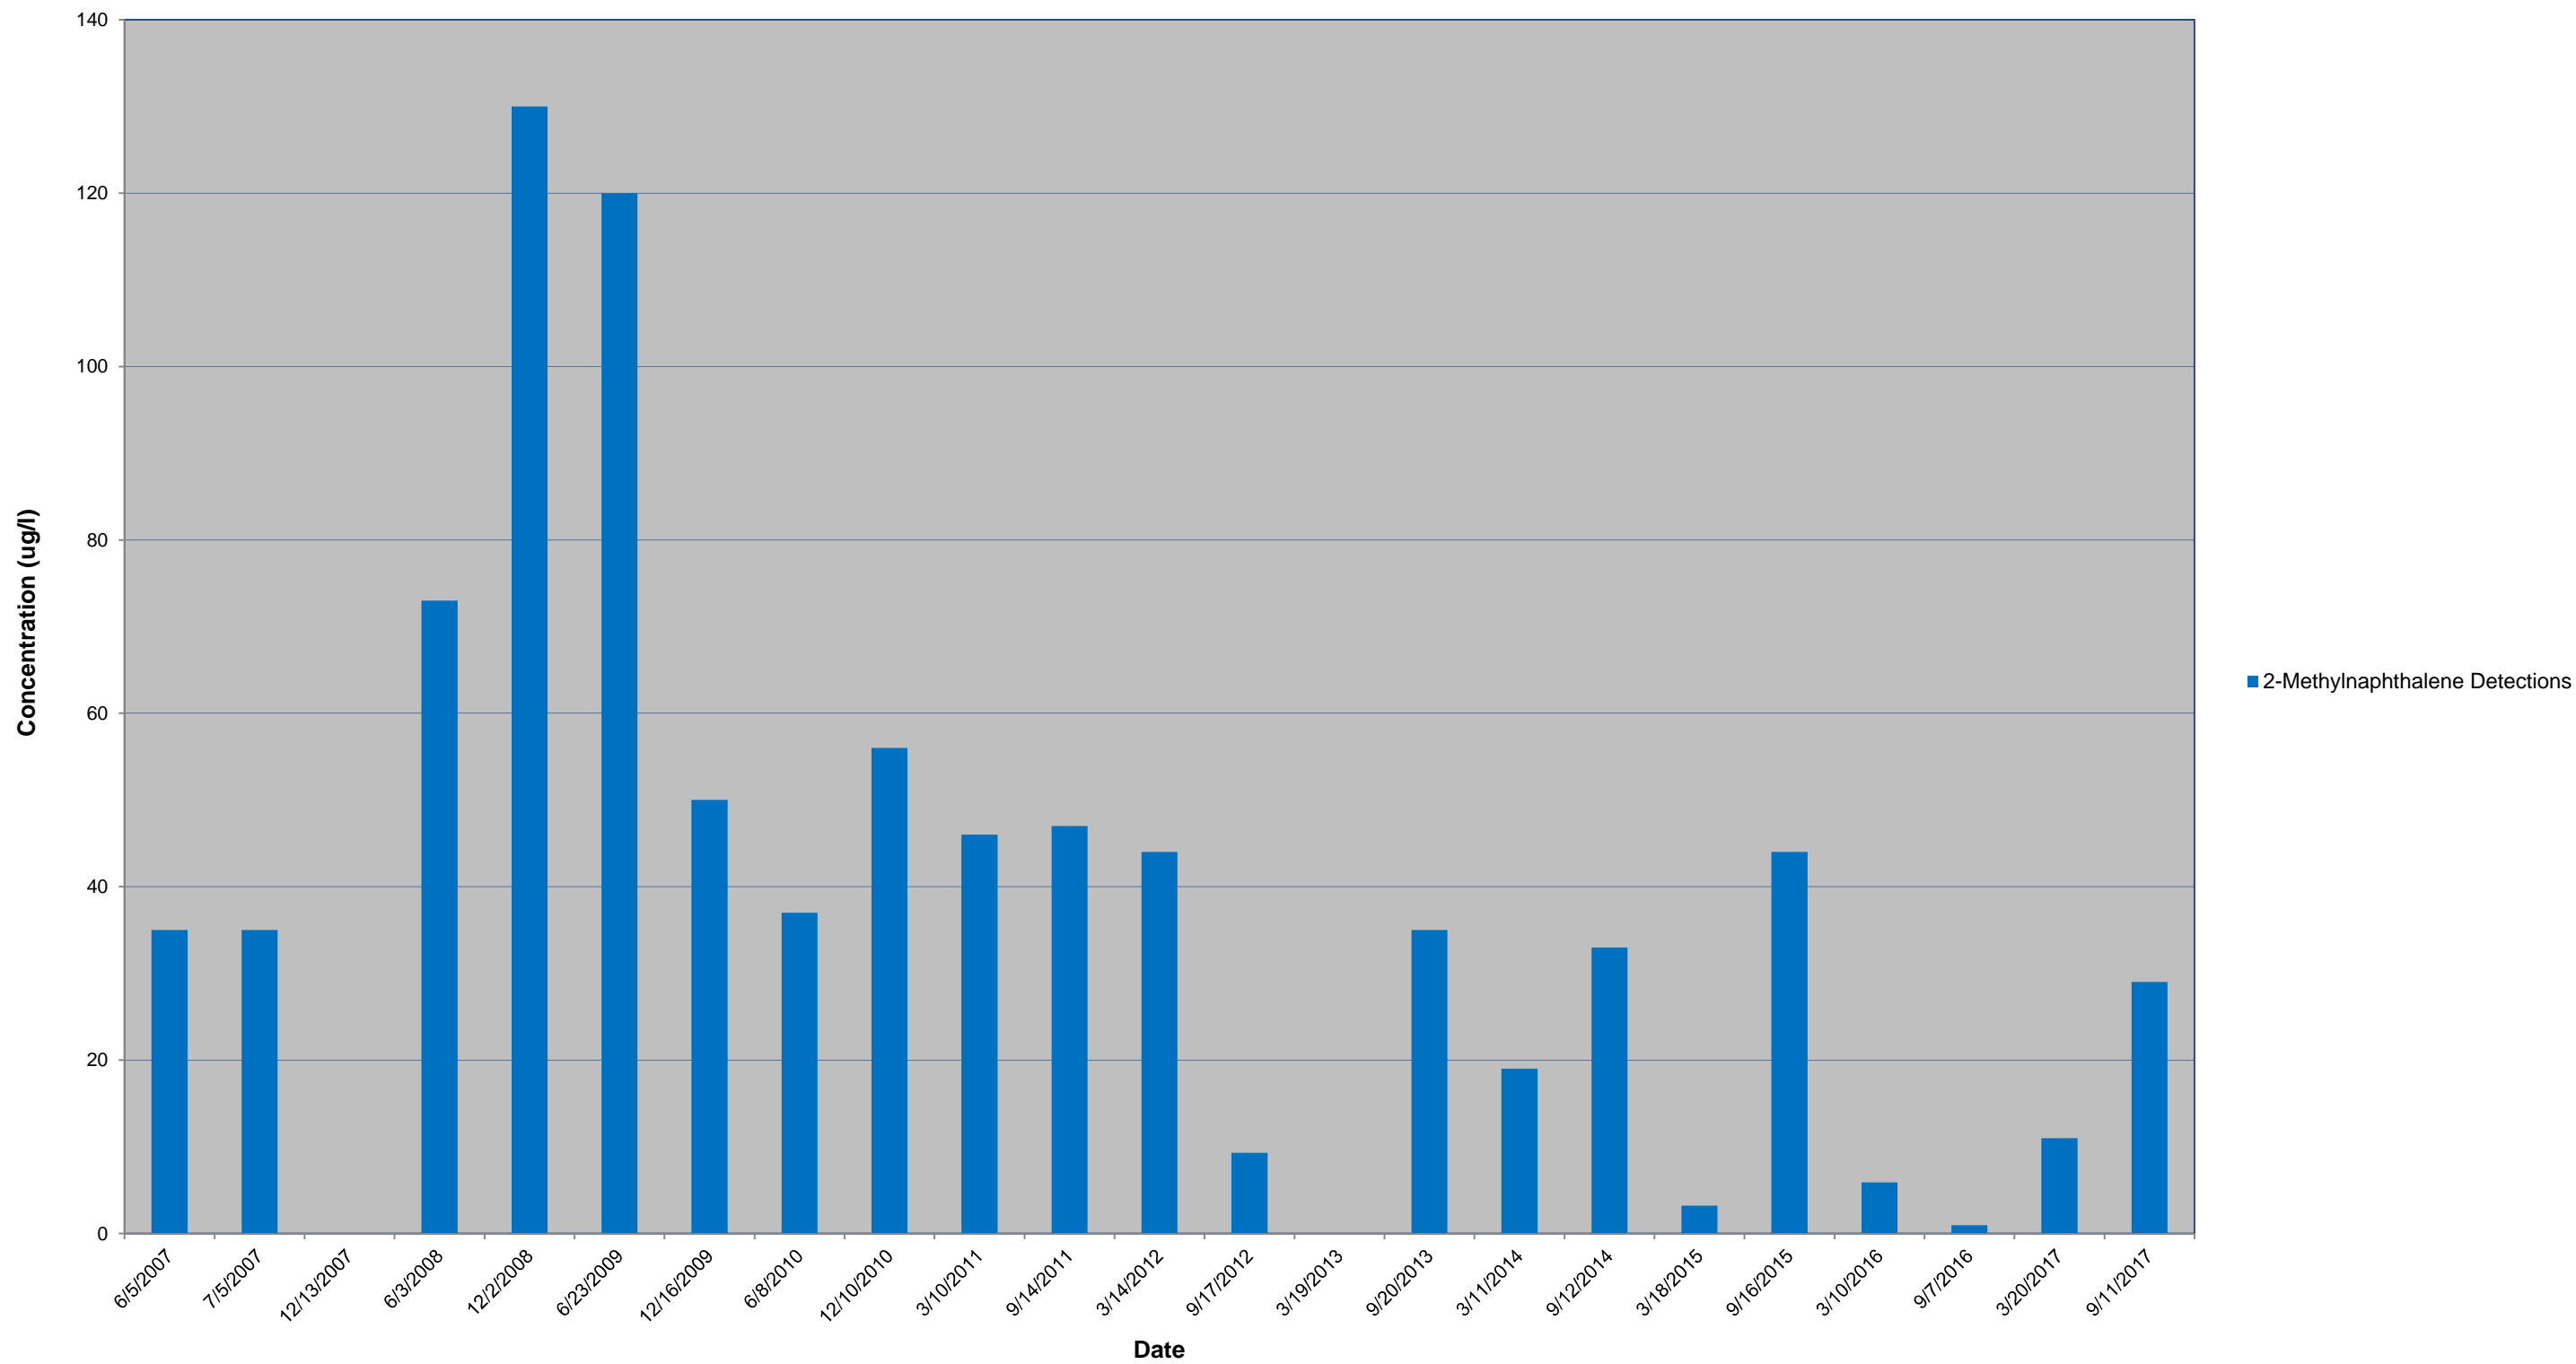


2-Methylphenol Detections in CAMU Unit 1 Leak Detection Samples
2007 - 2017

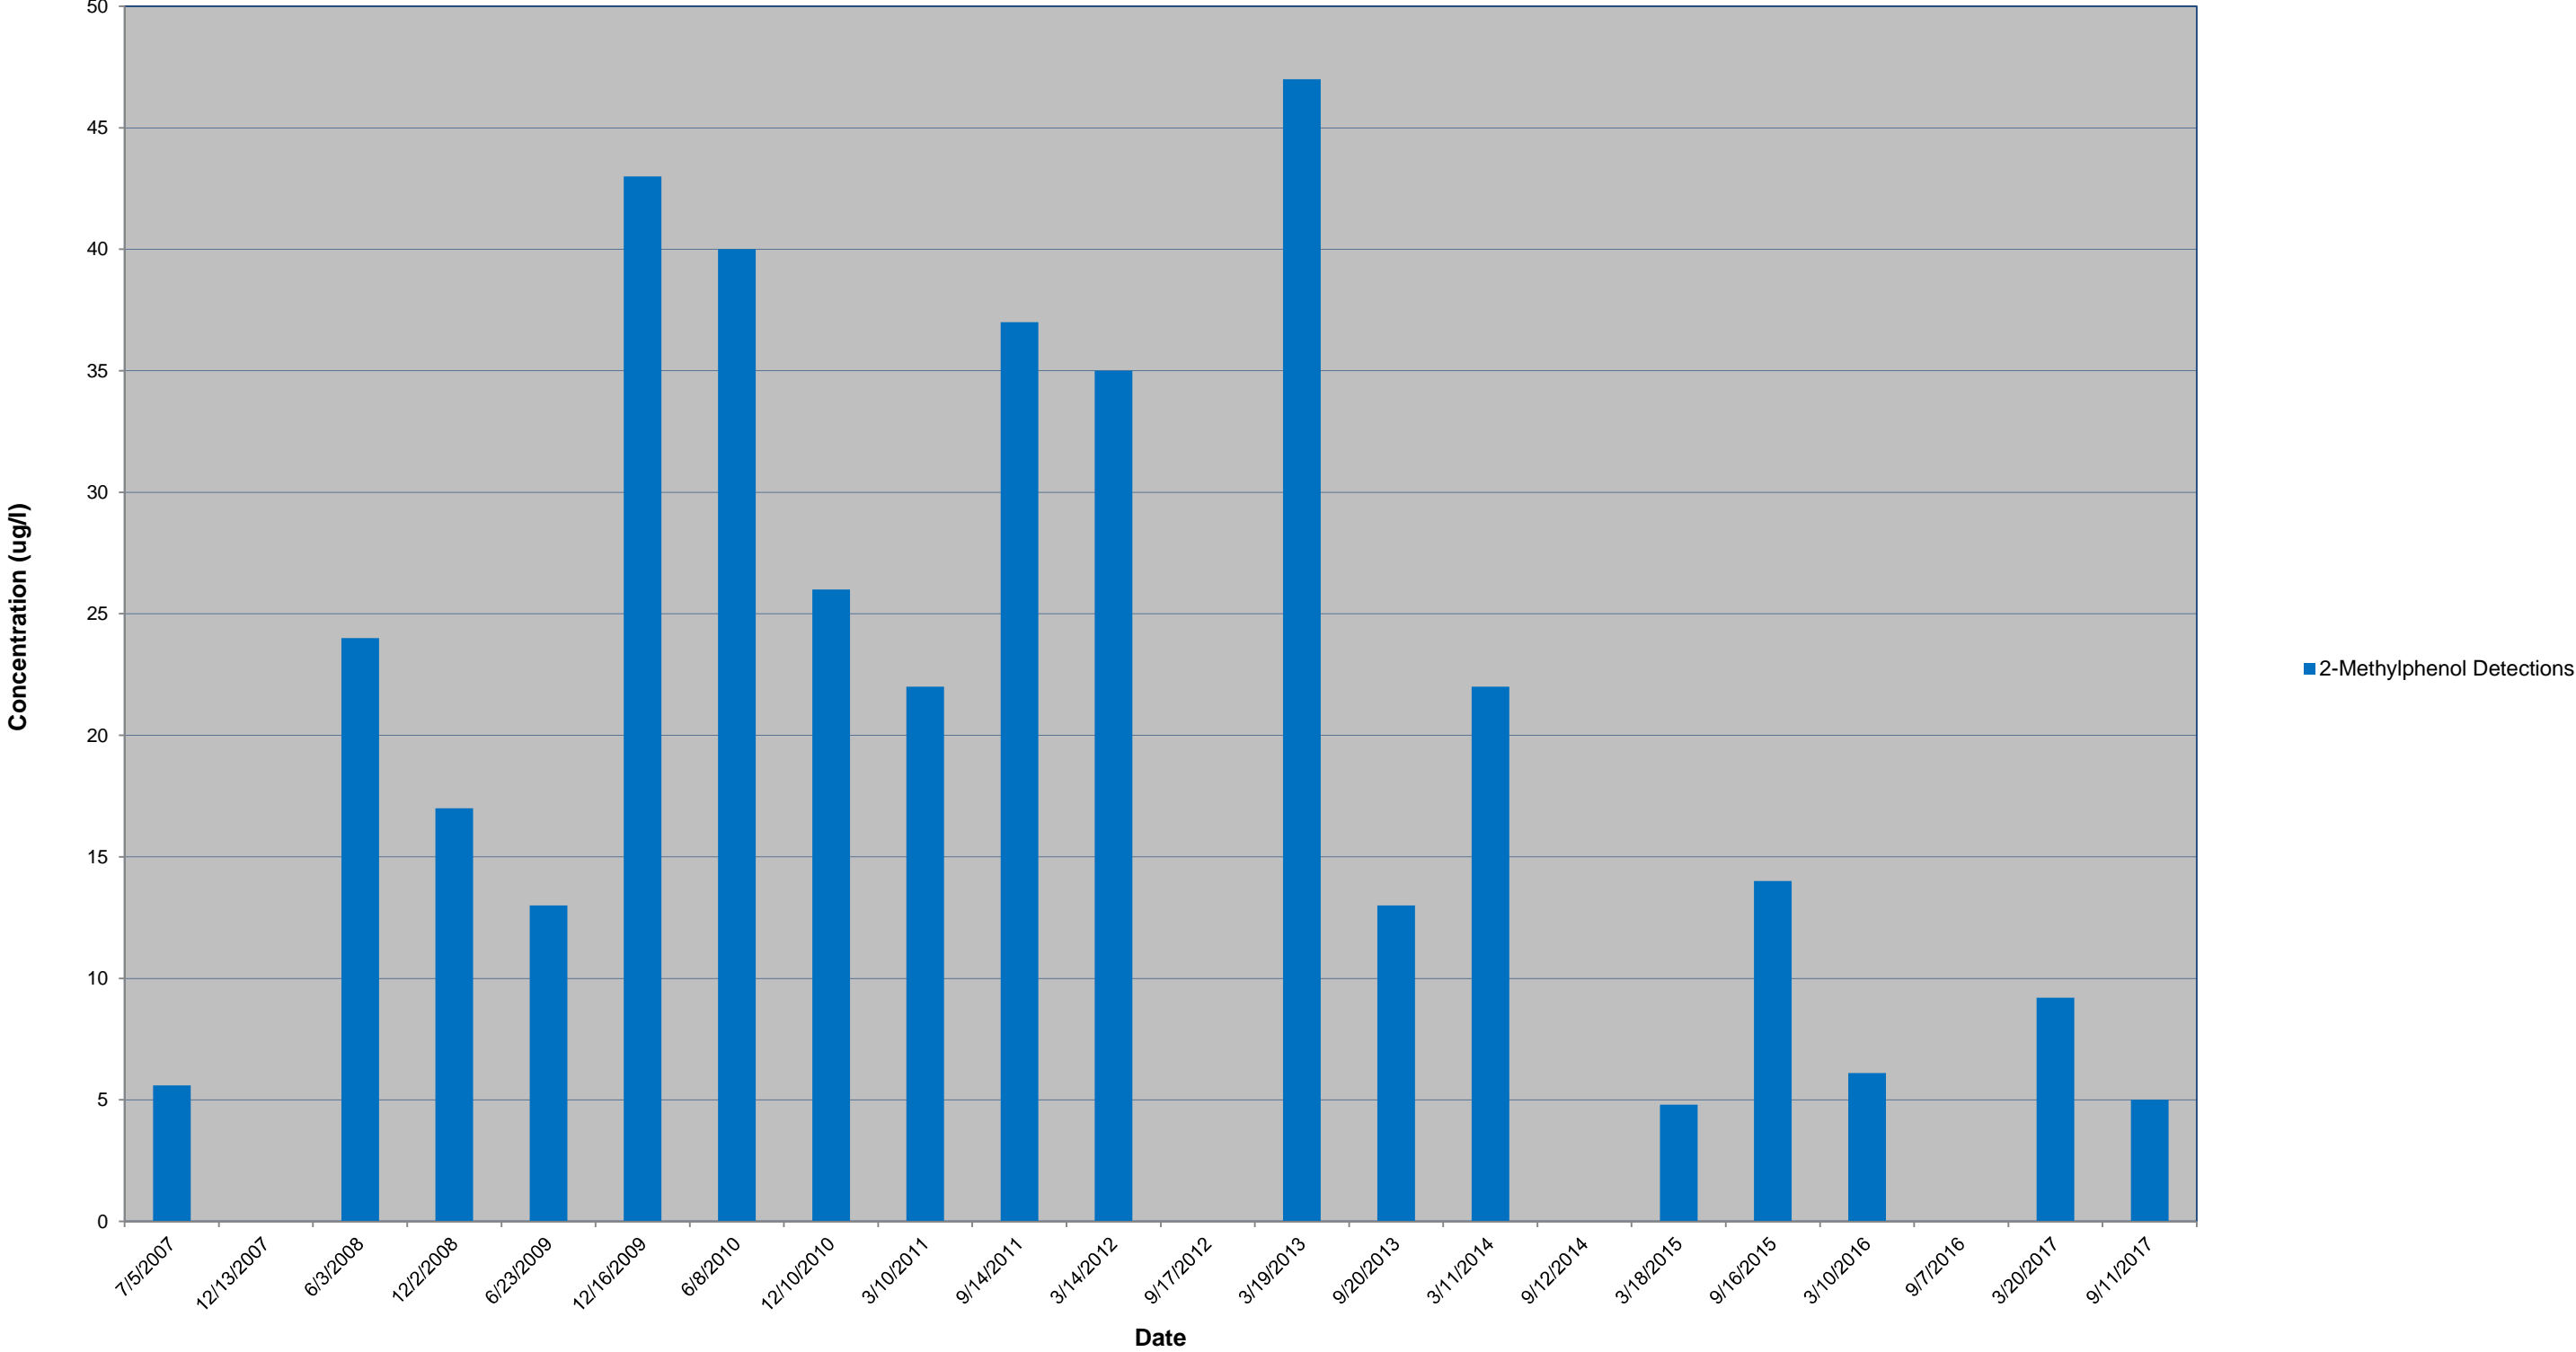


2-Picoline Detections in CAMU Unit 1 Leak Detection Samples
2007 - 2017

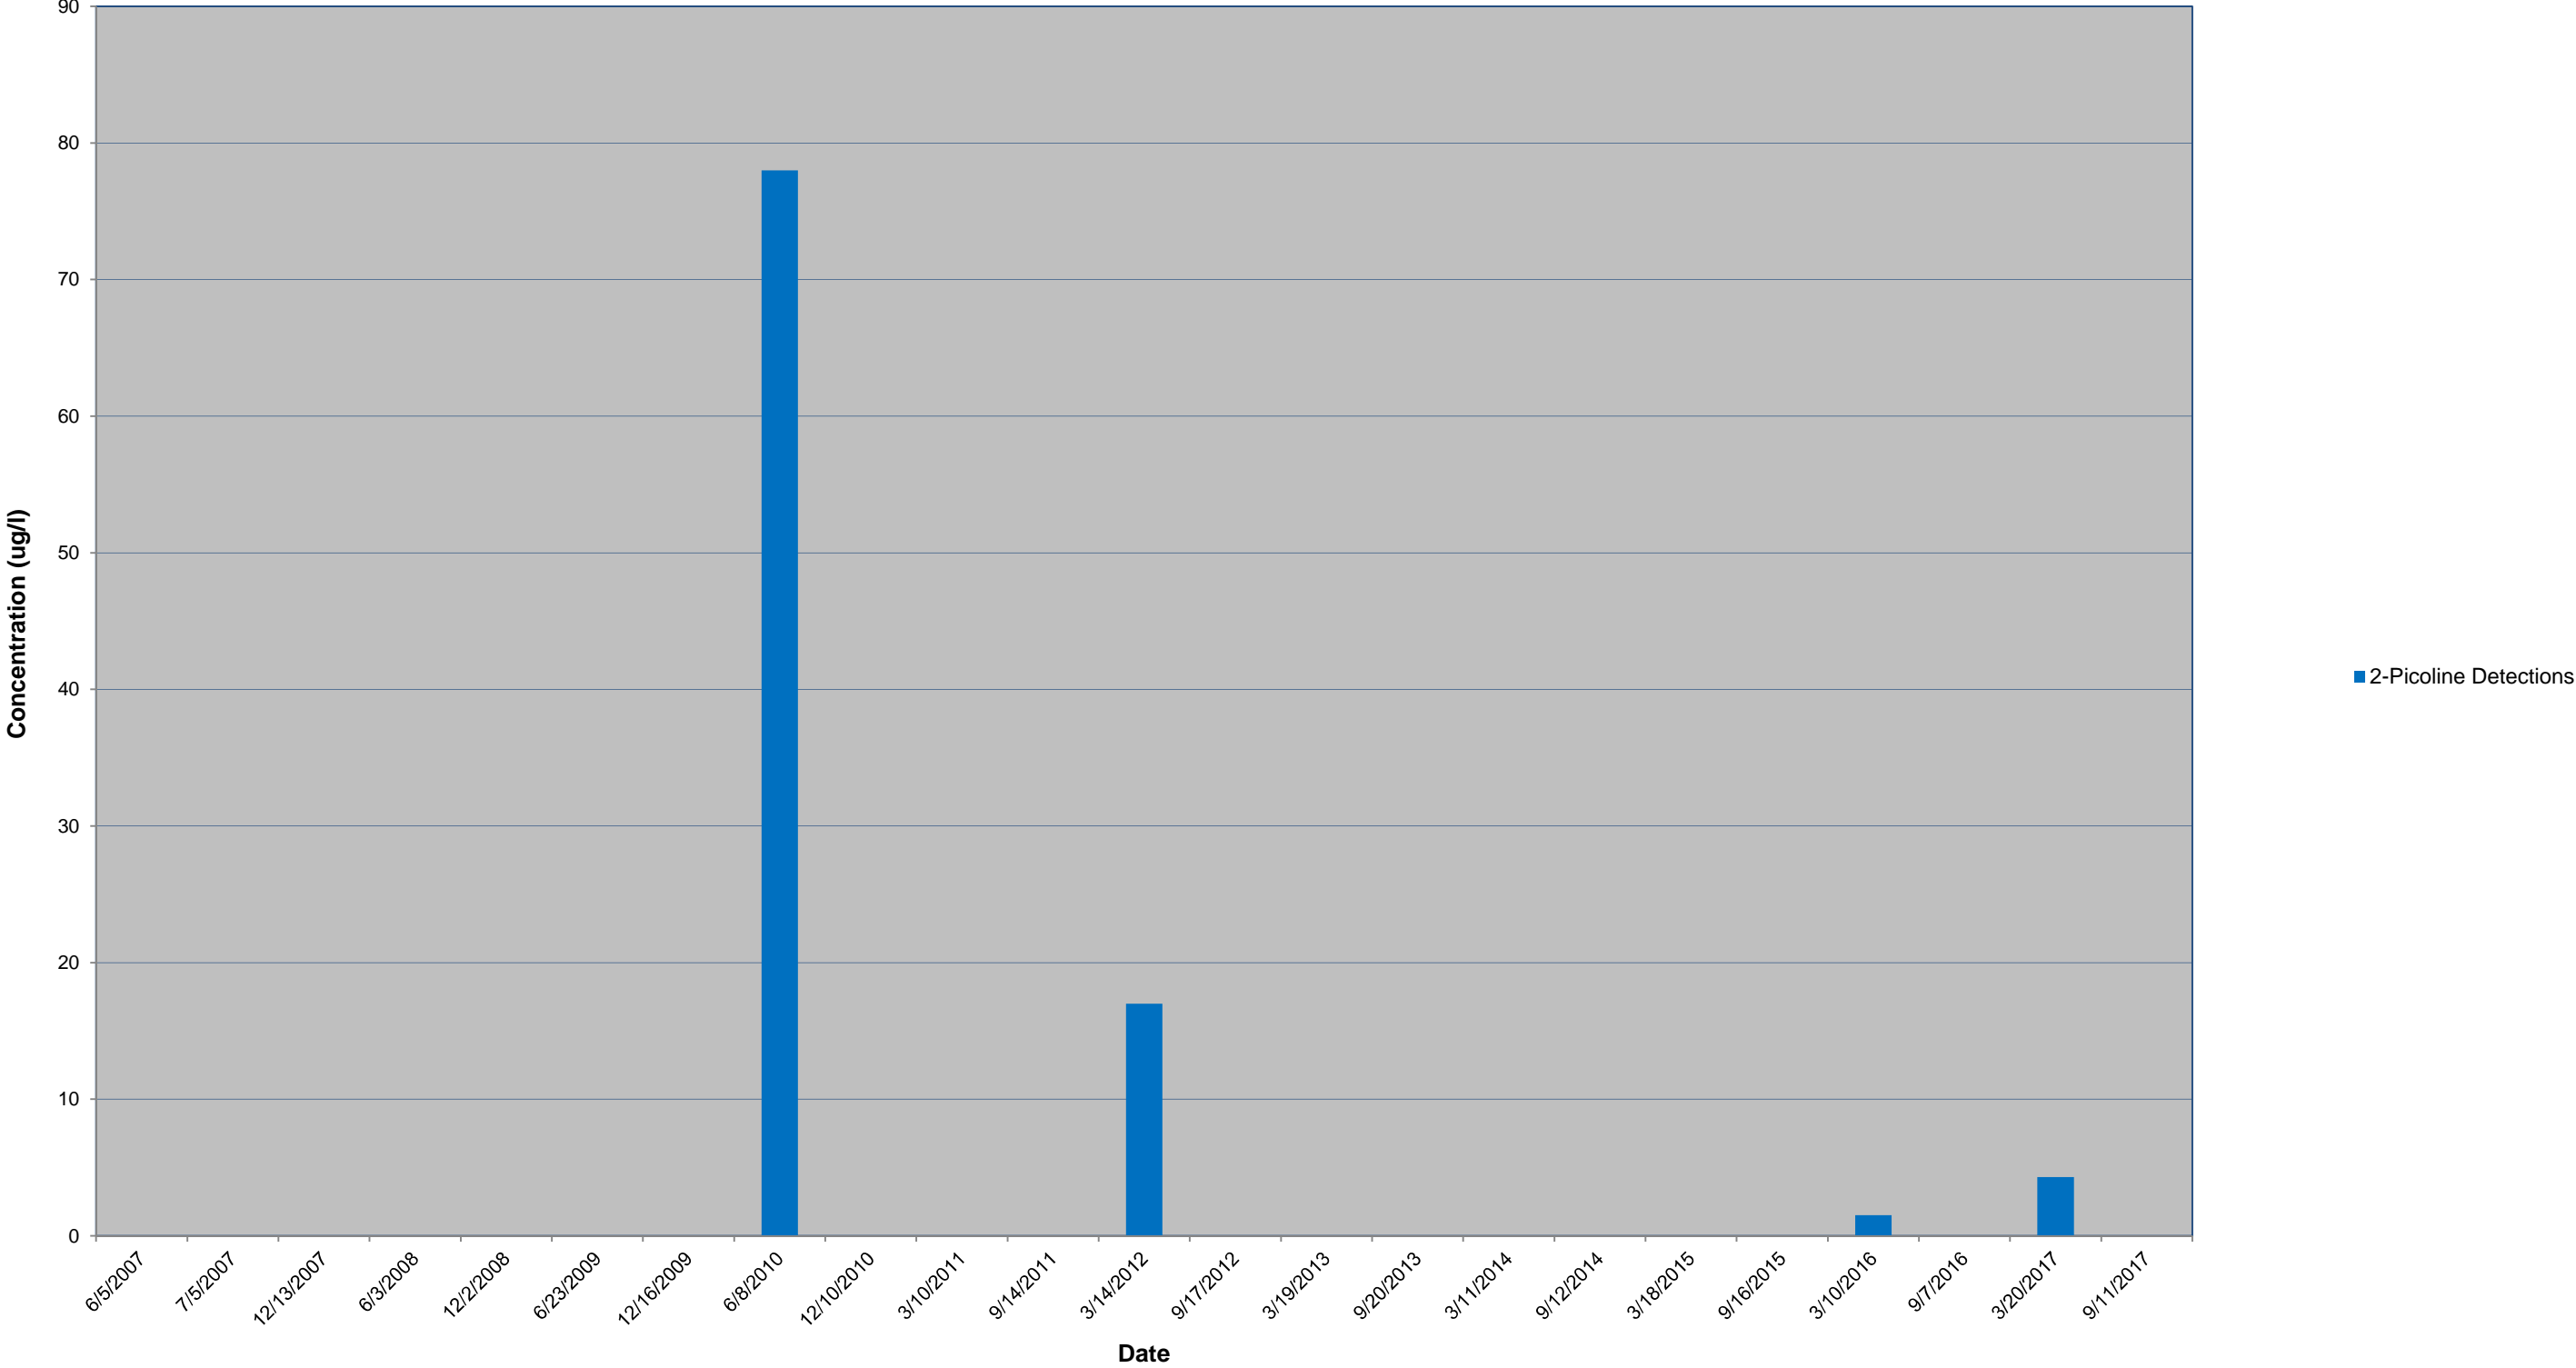


2,4-Dimethylphenol Detections in CAMU Unit 1 Leak Detection Samples
2007 - 2017

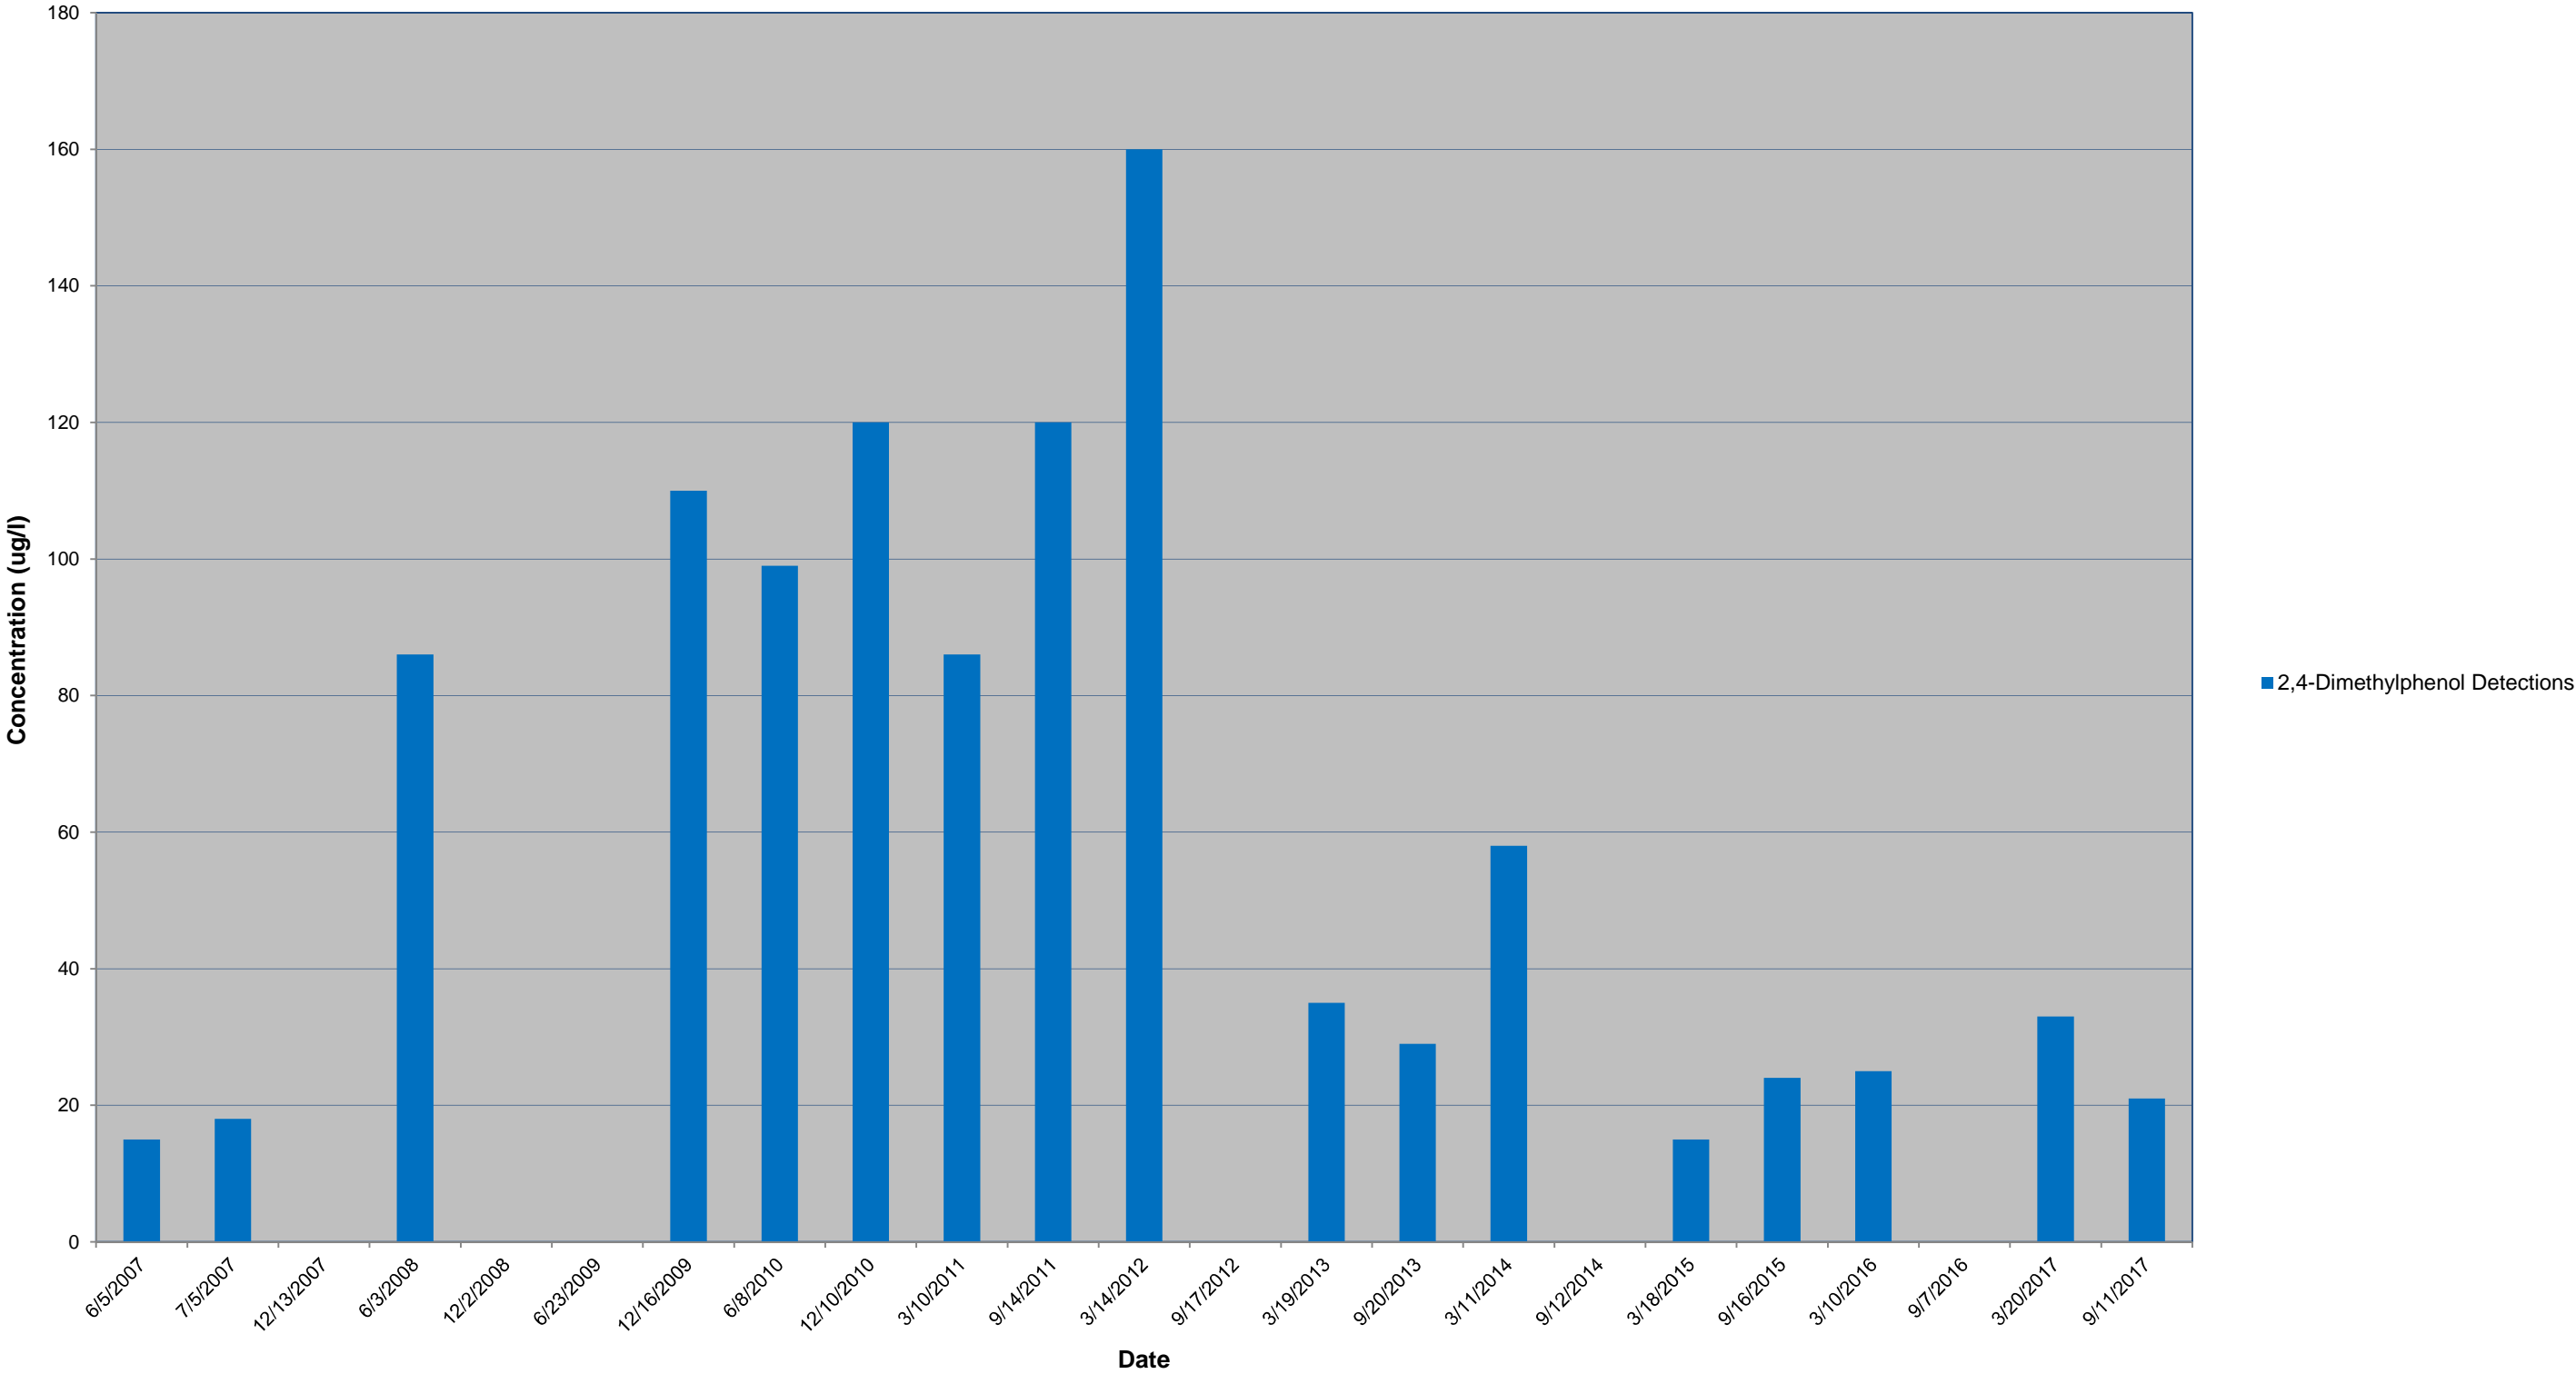


3&4-Methylphenol Detections in CAMU Unit 1 Leak Detection Samples
2007 - 2017

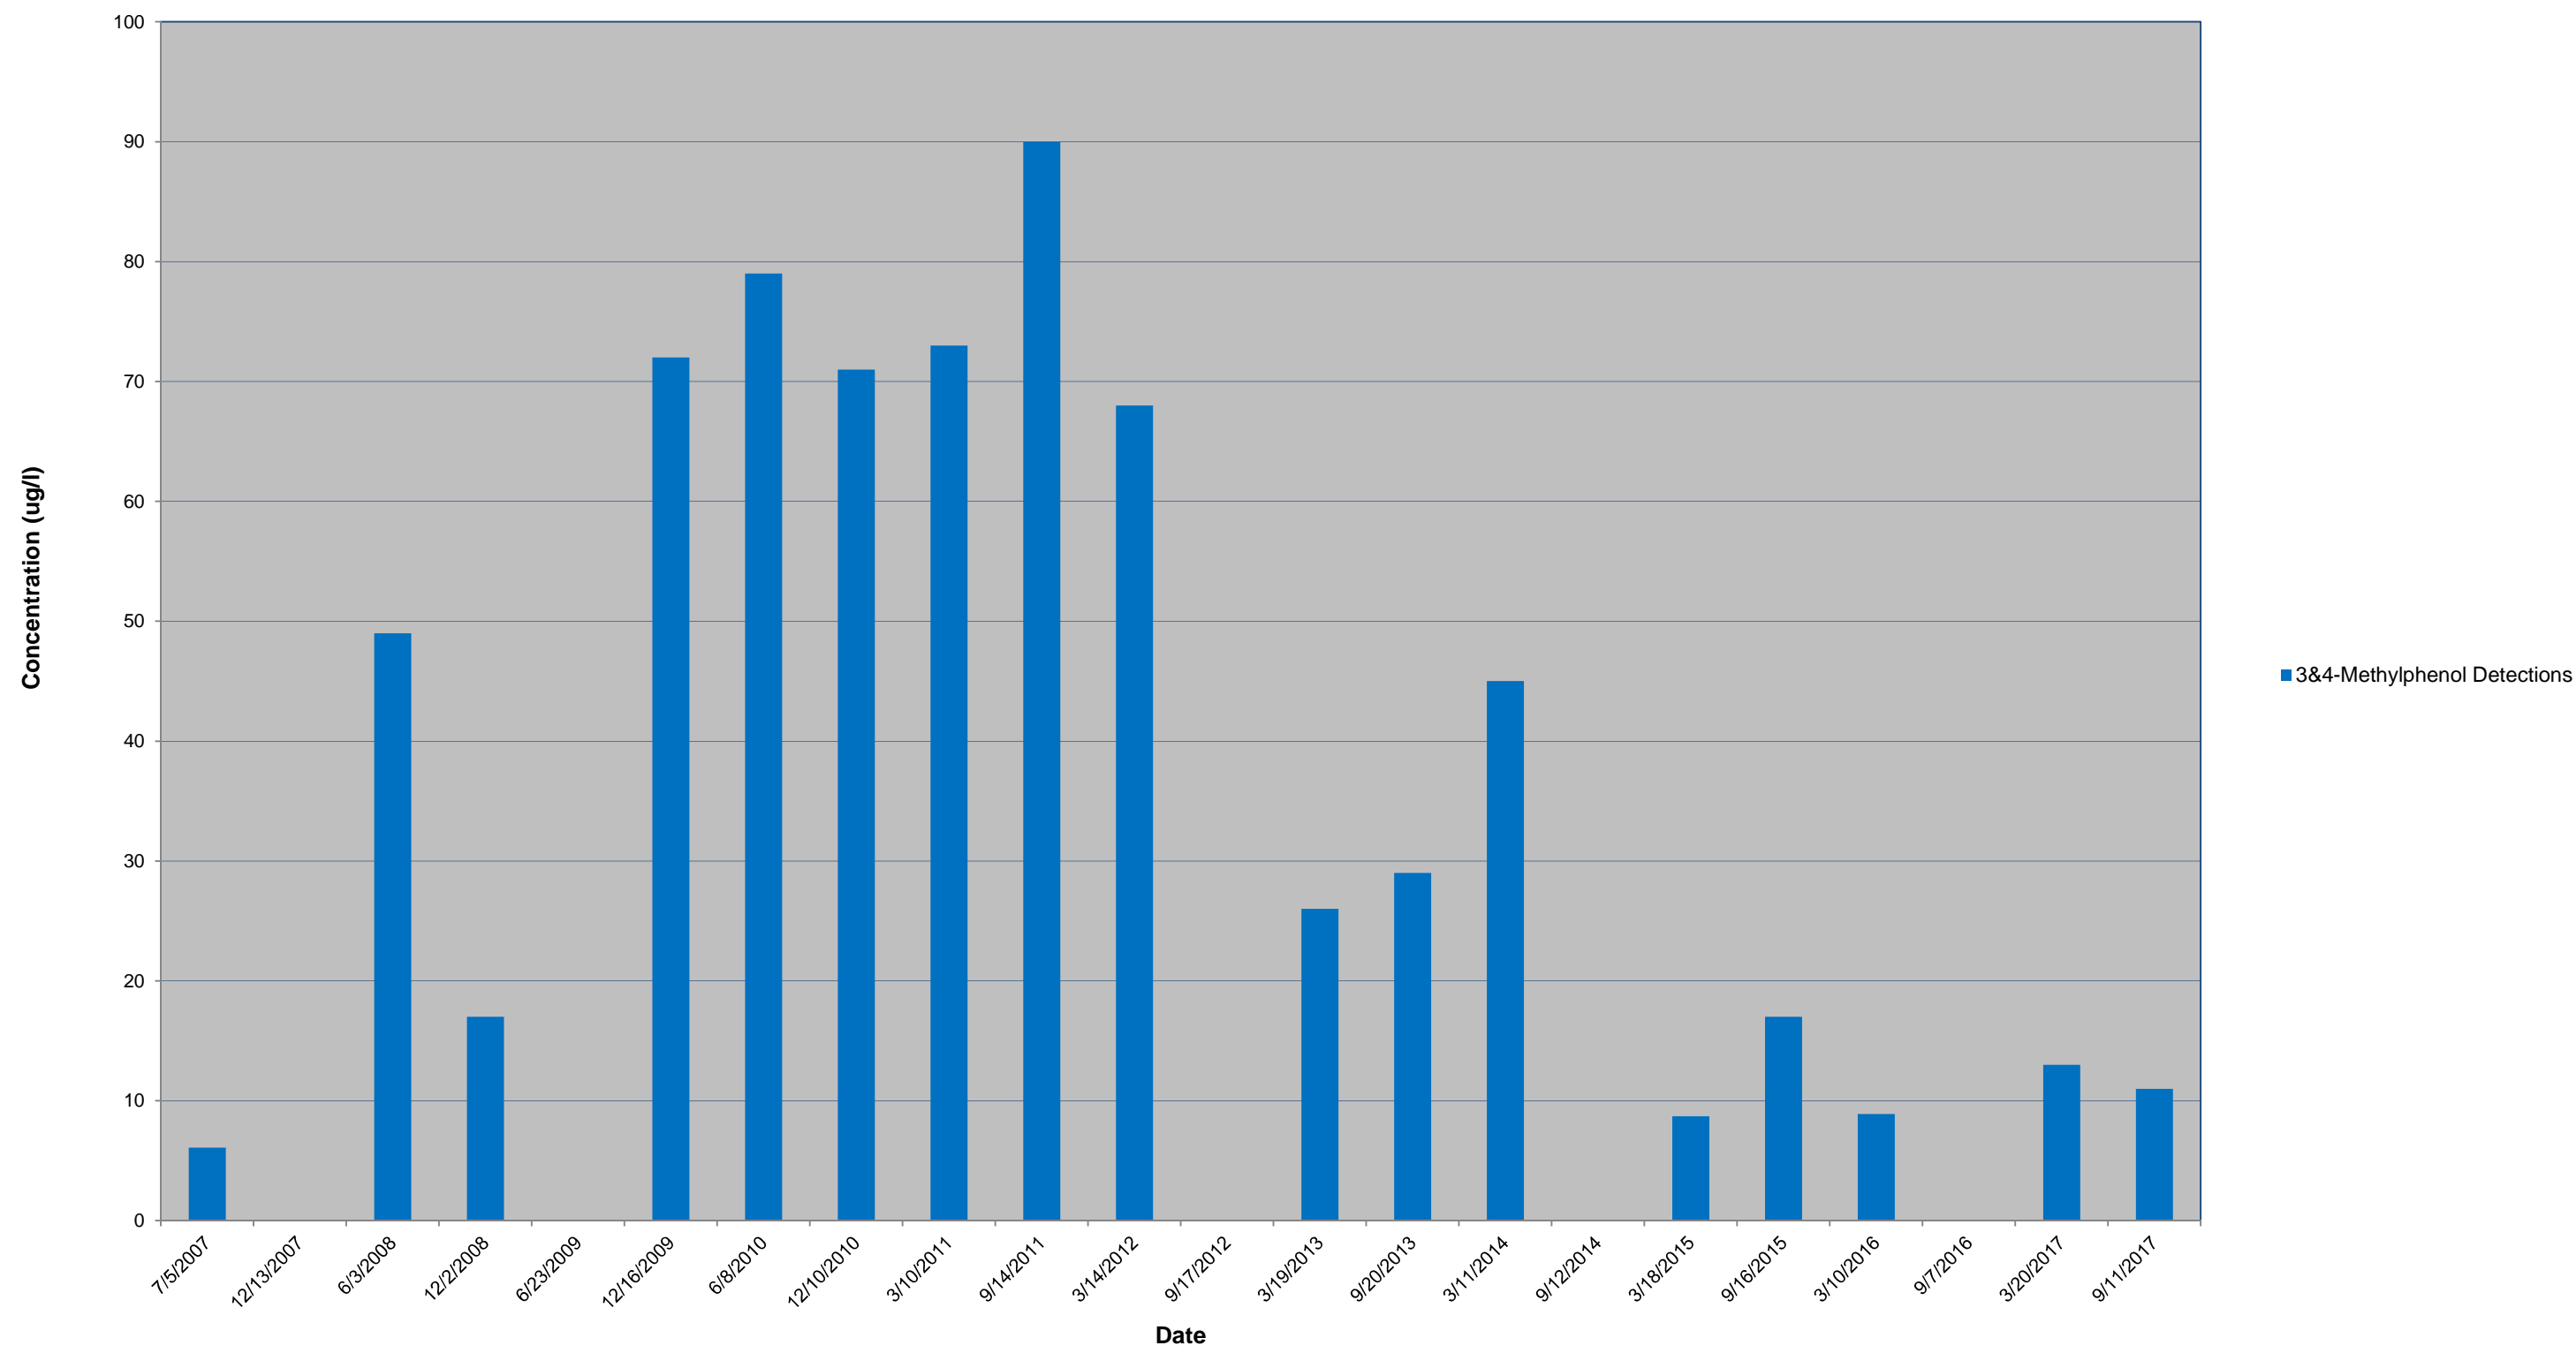


Acenaphthene Detections in CAMU Unit 1 Leak Detection Samples
2007 - 2017

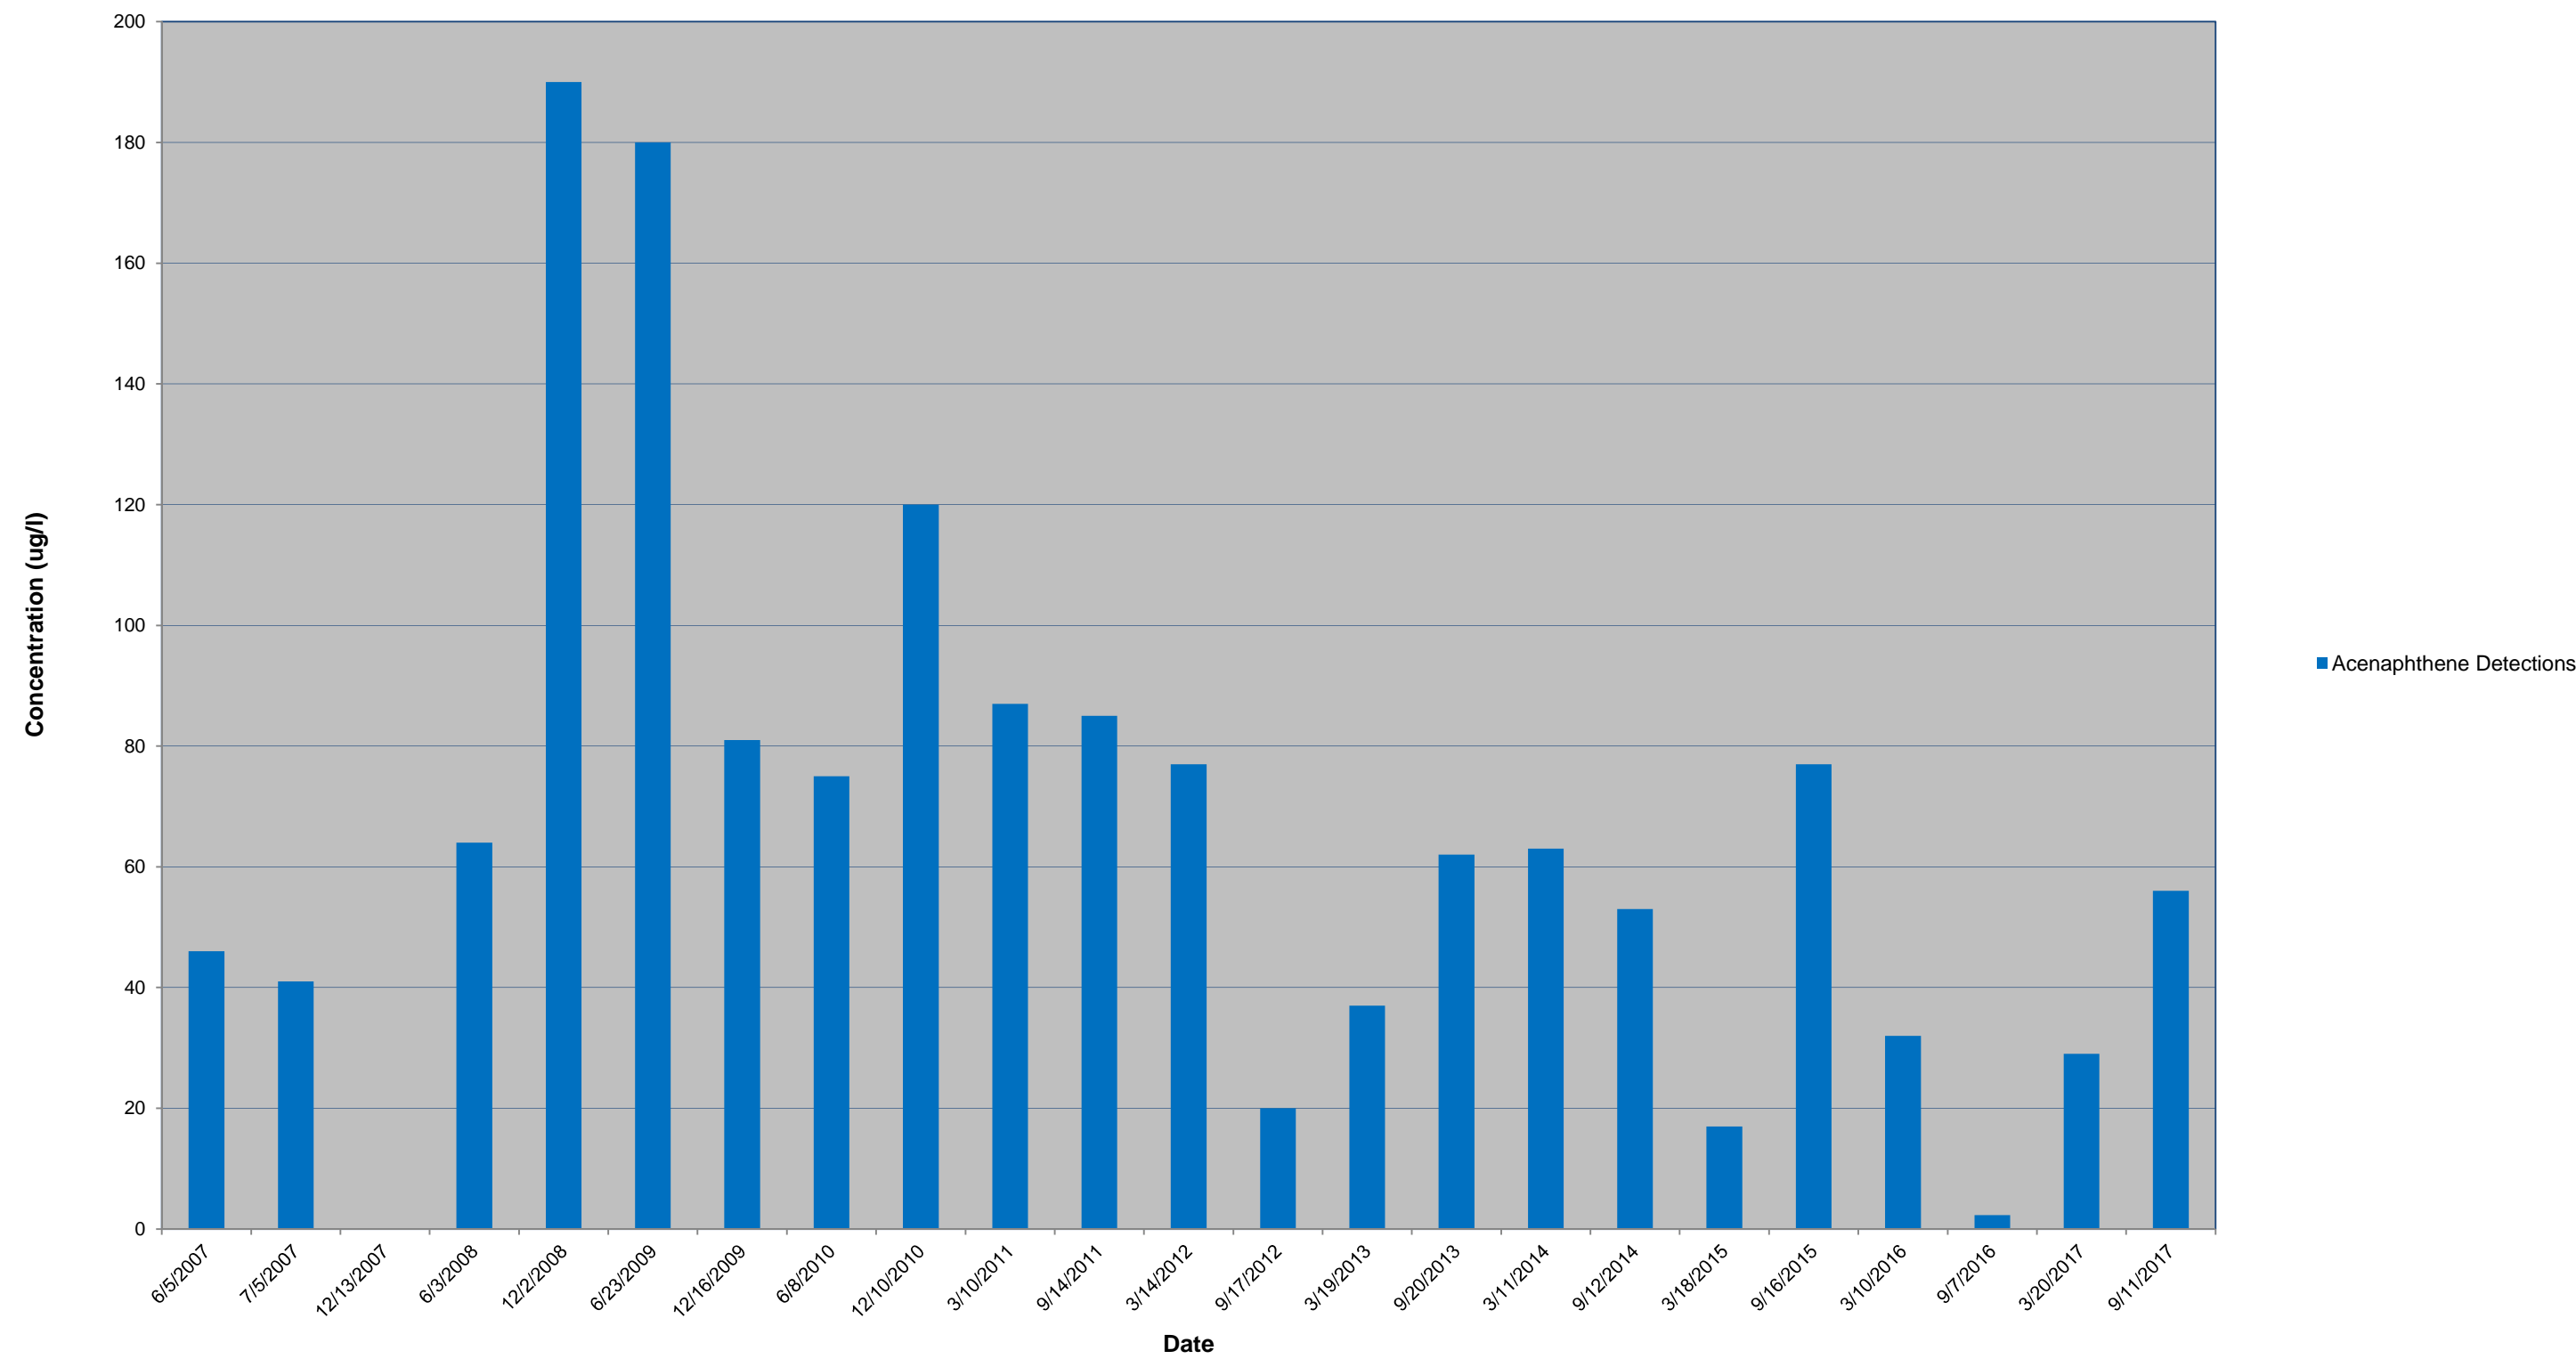


Acenaphthylene Detections in CAMU Unit 1 Leak Detection Samples
2007 - 2017

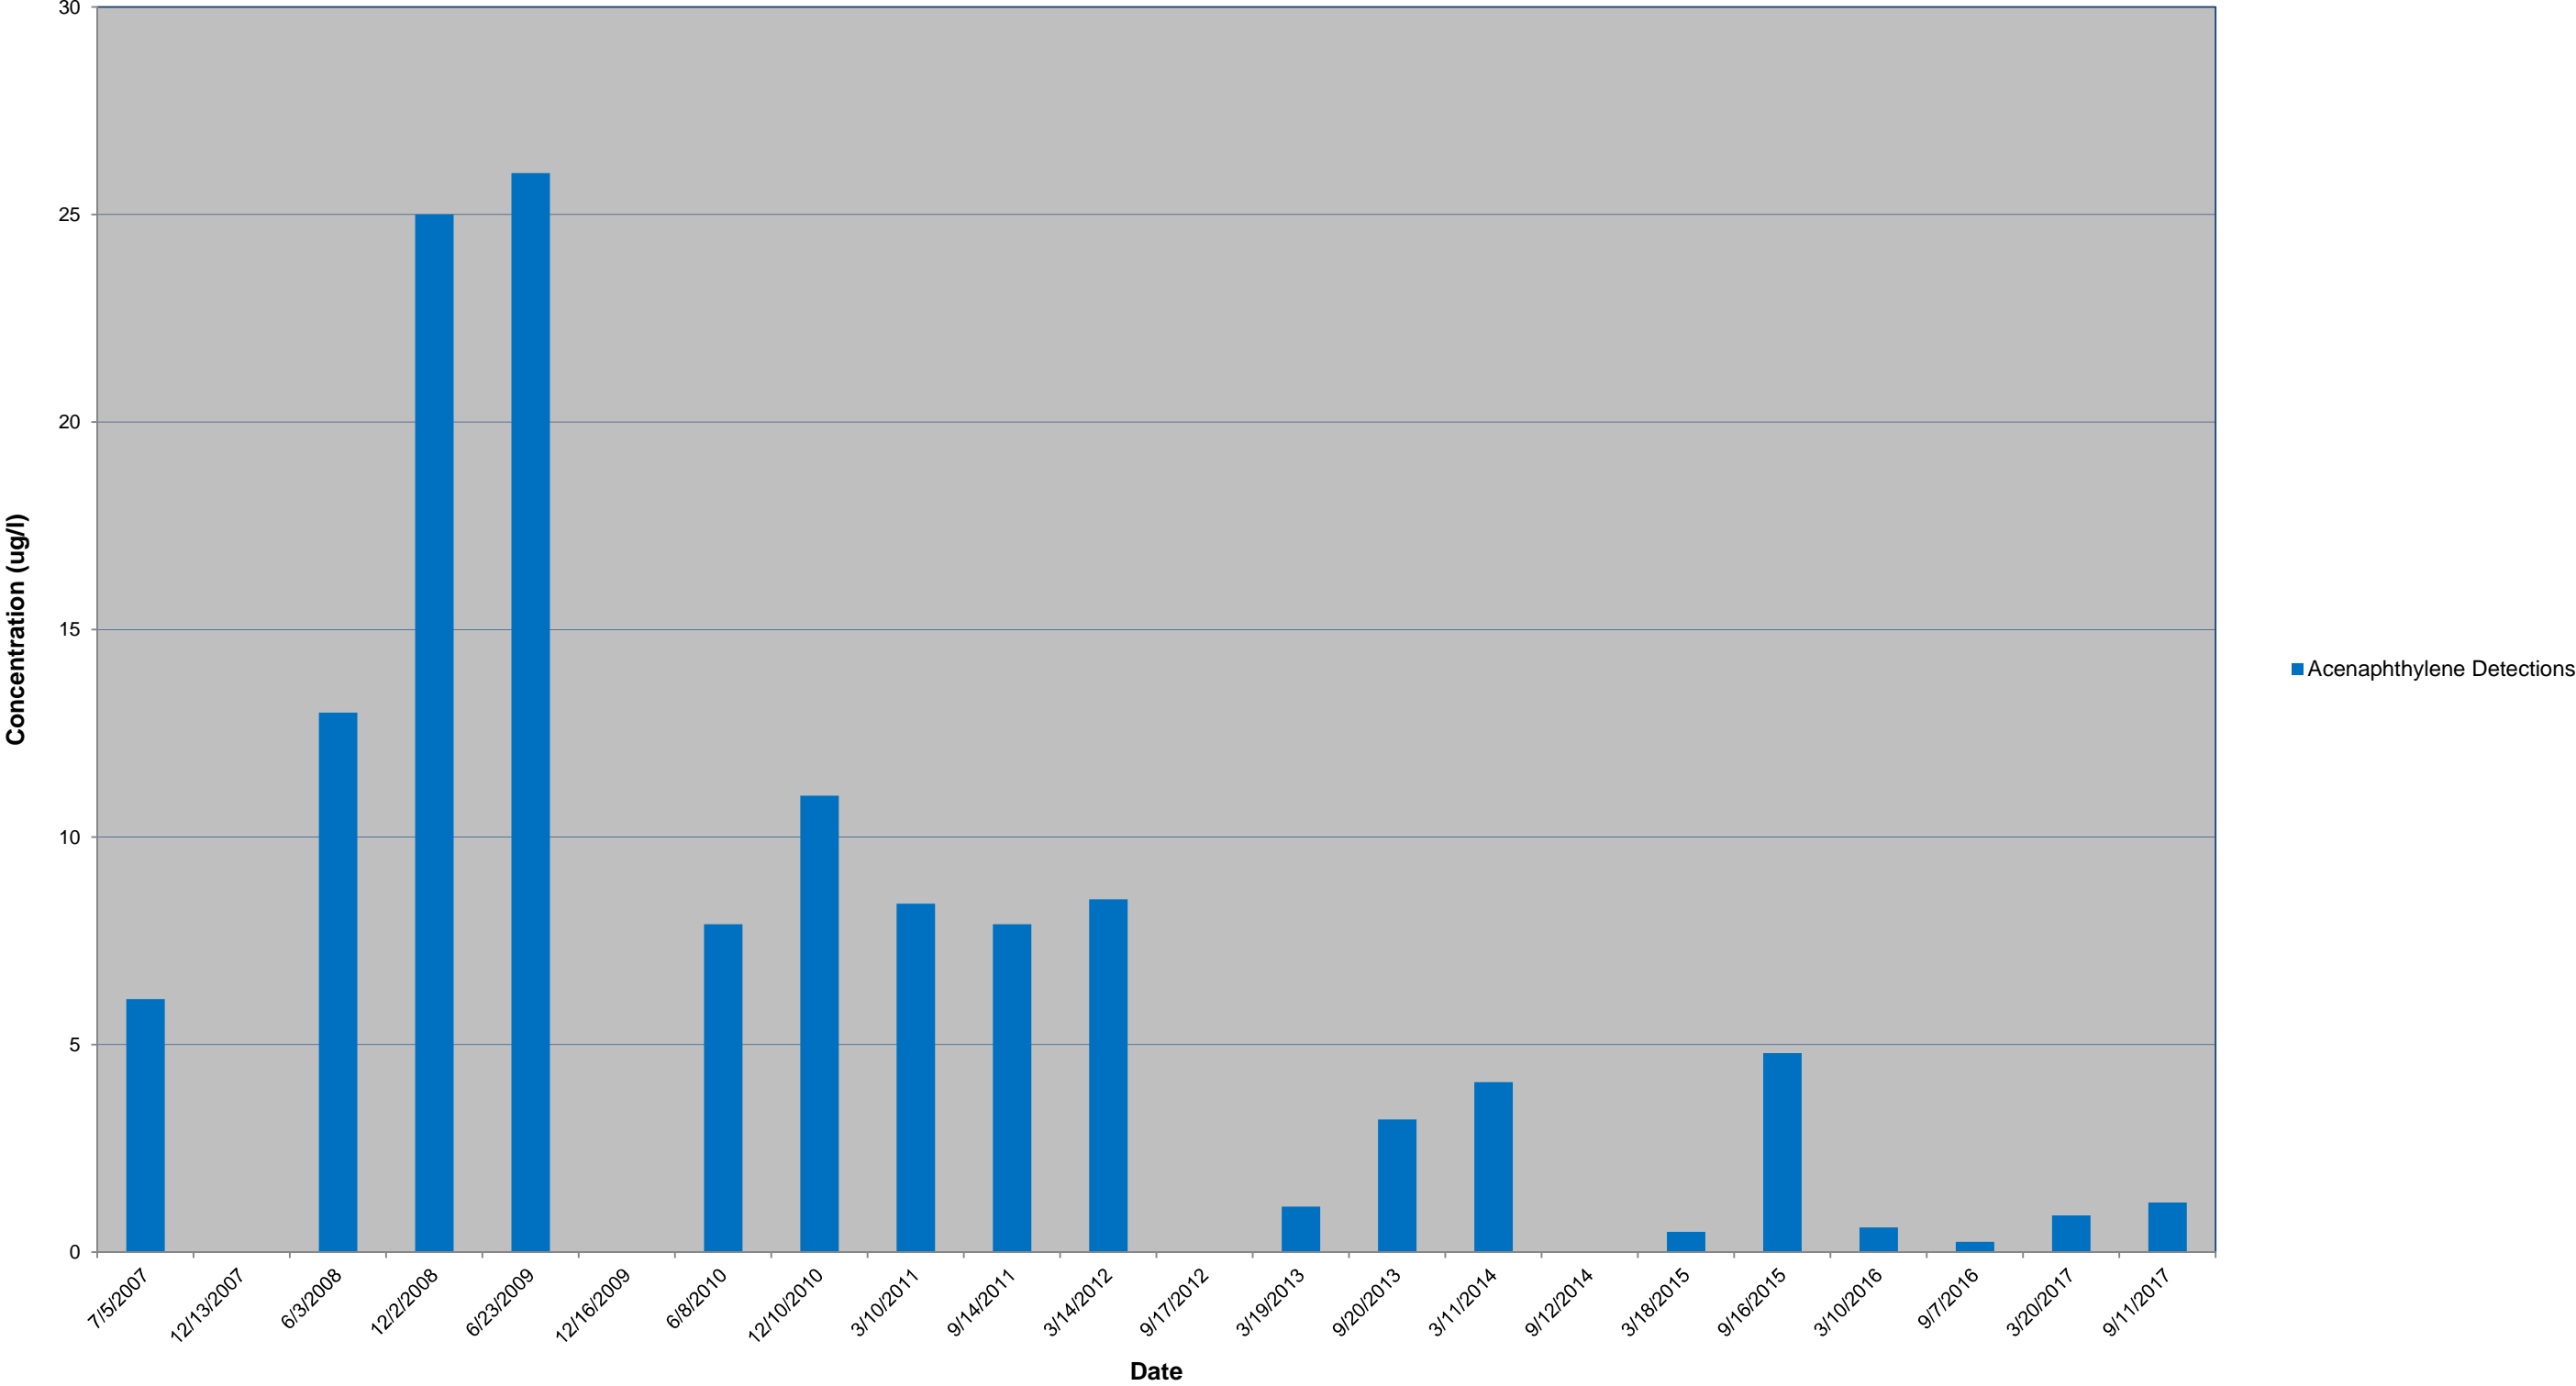


Acetophenone Detections in CAMU Unit 1 Leak Detection Samples
2007 - 2017

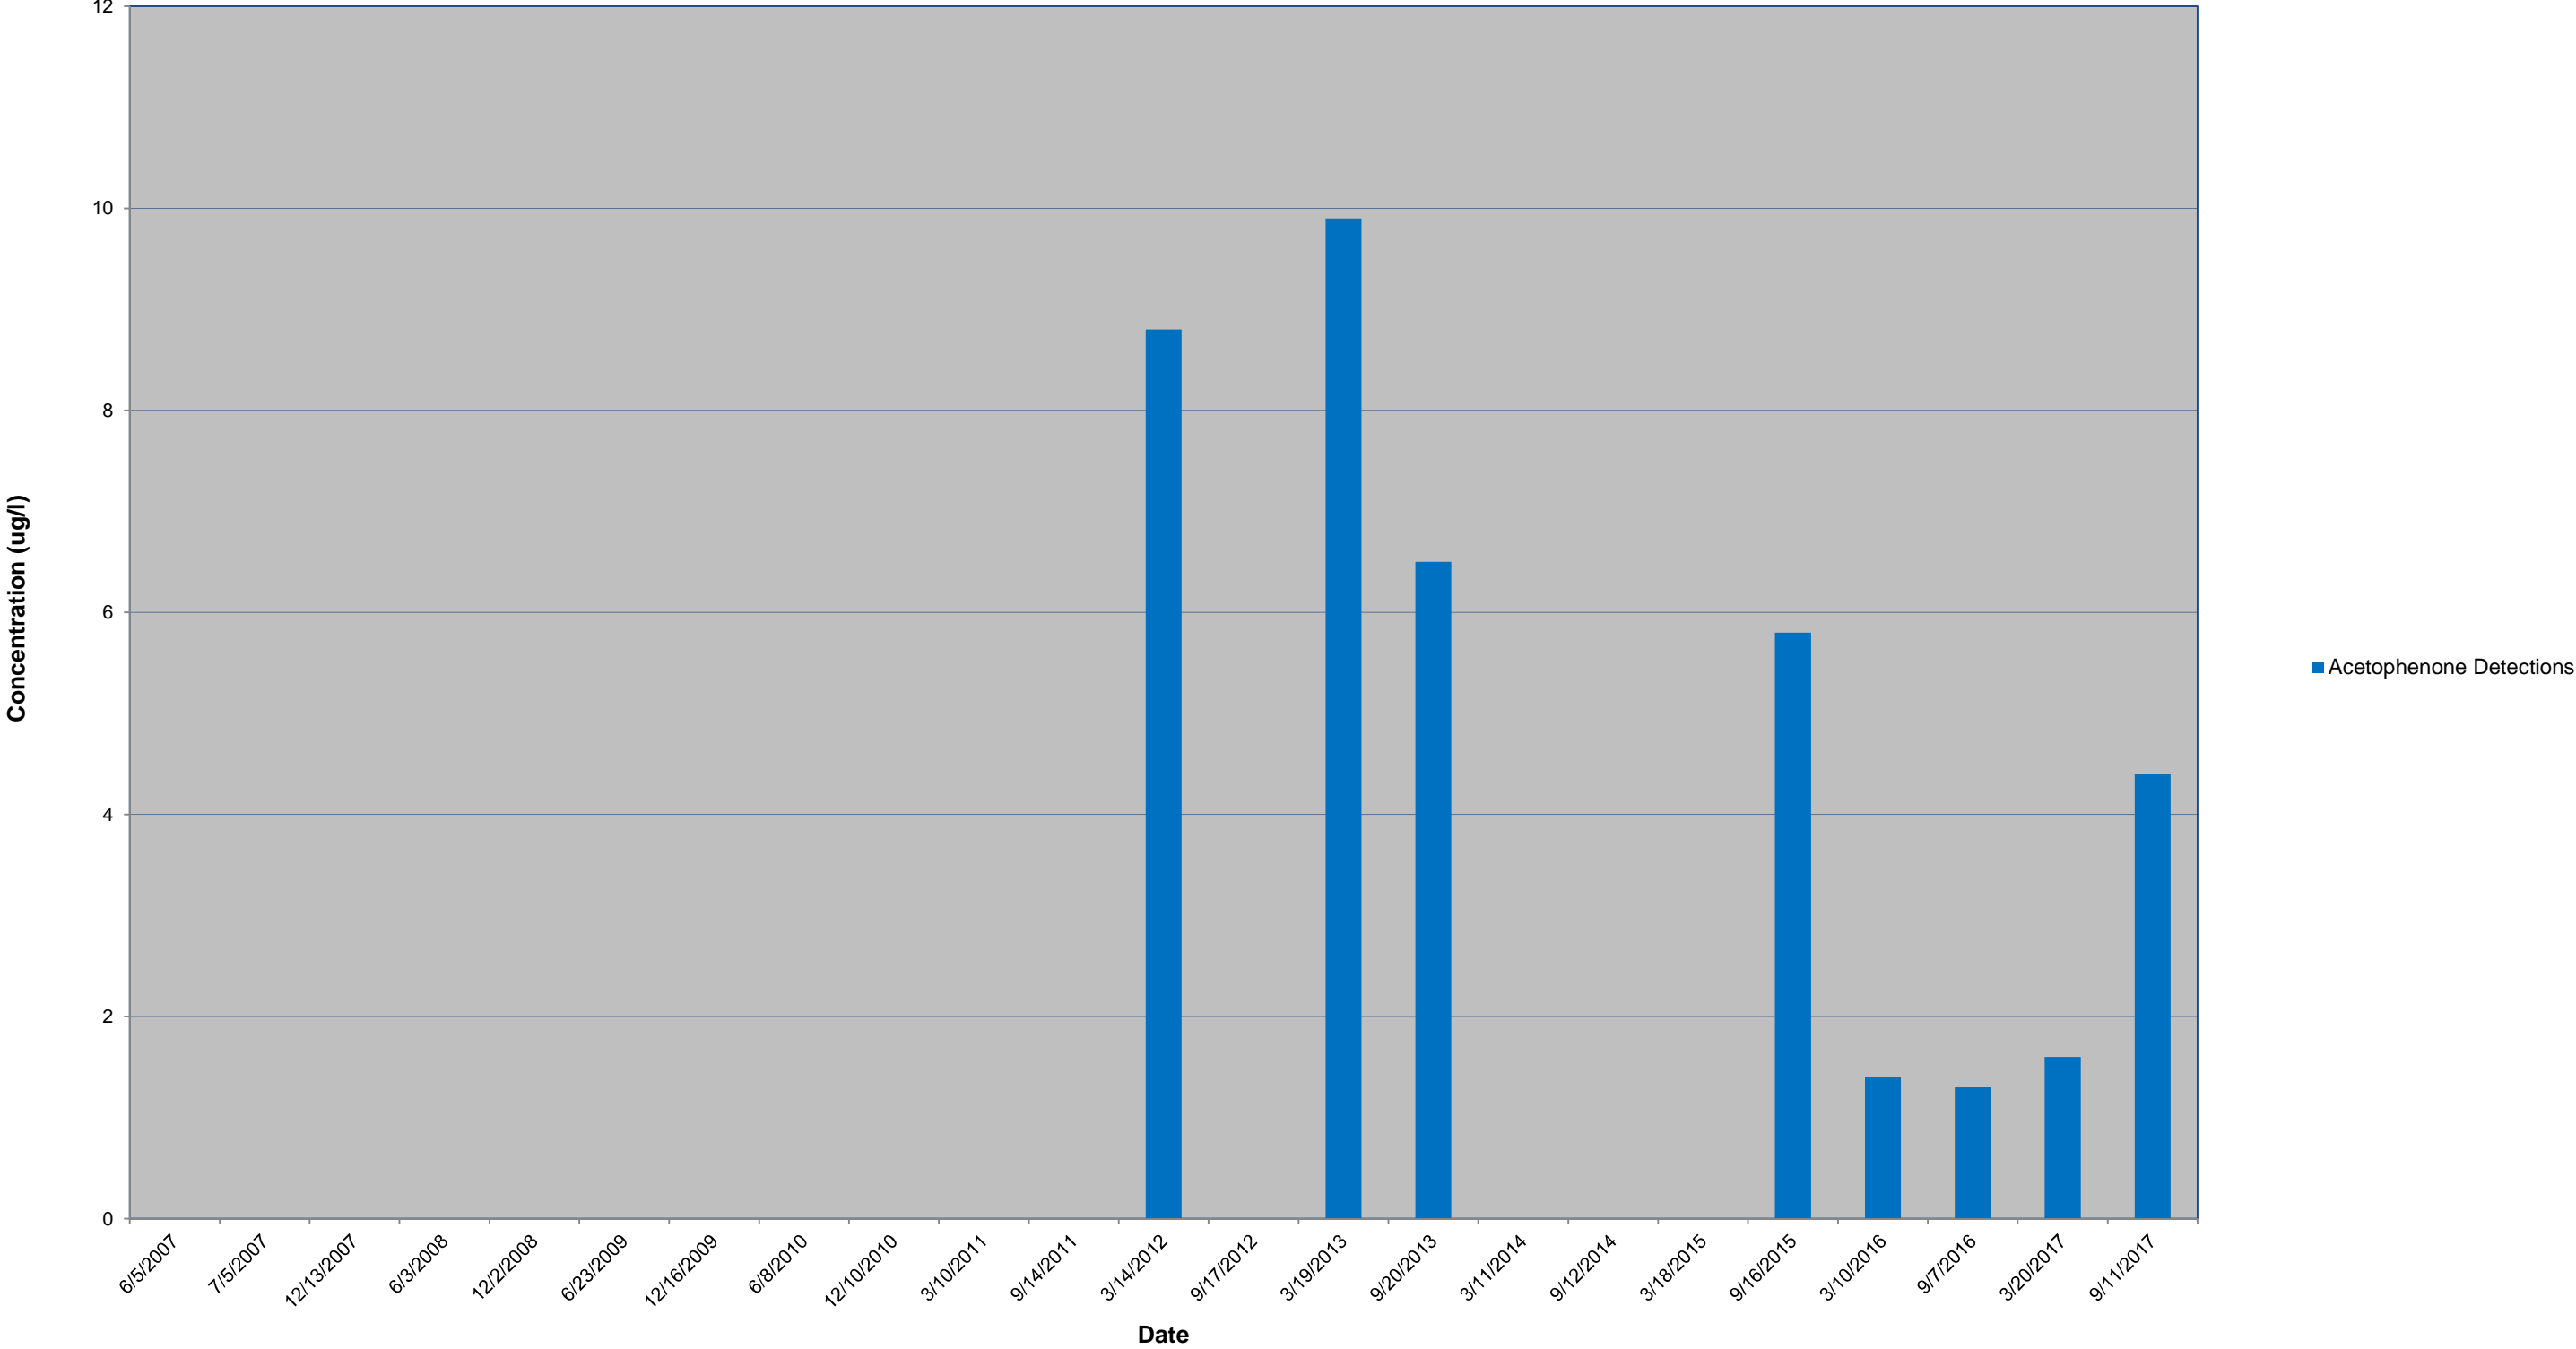


Anthracene Detections in CAMU Unit 1 Leak Detection Samples
2007 - 2017

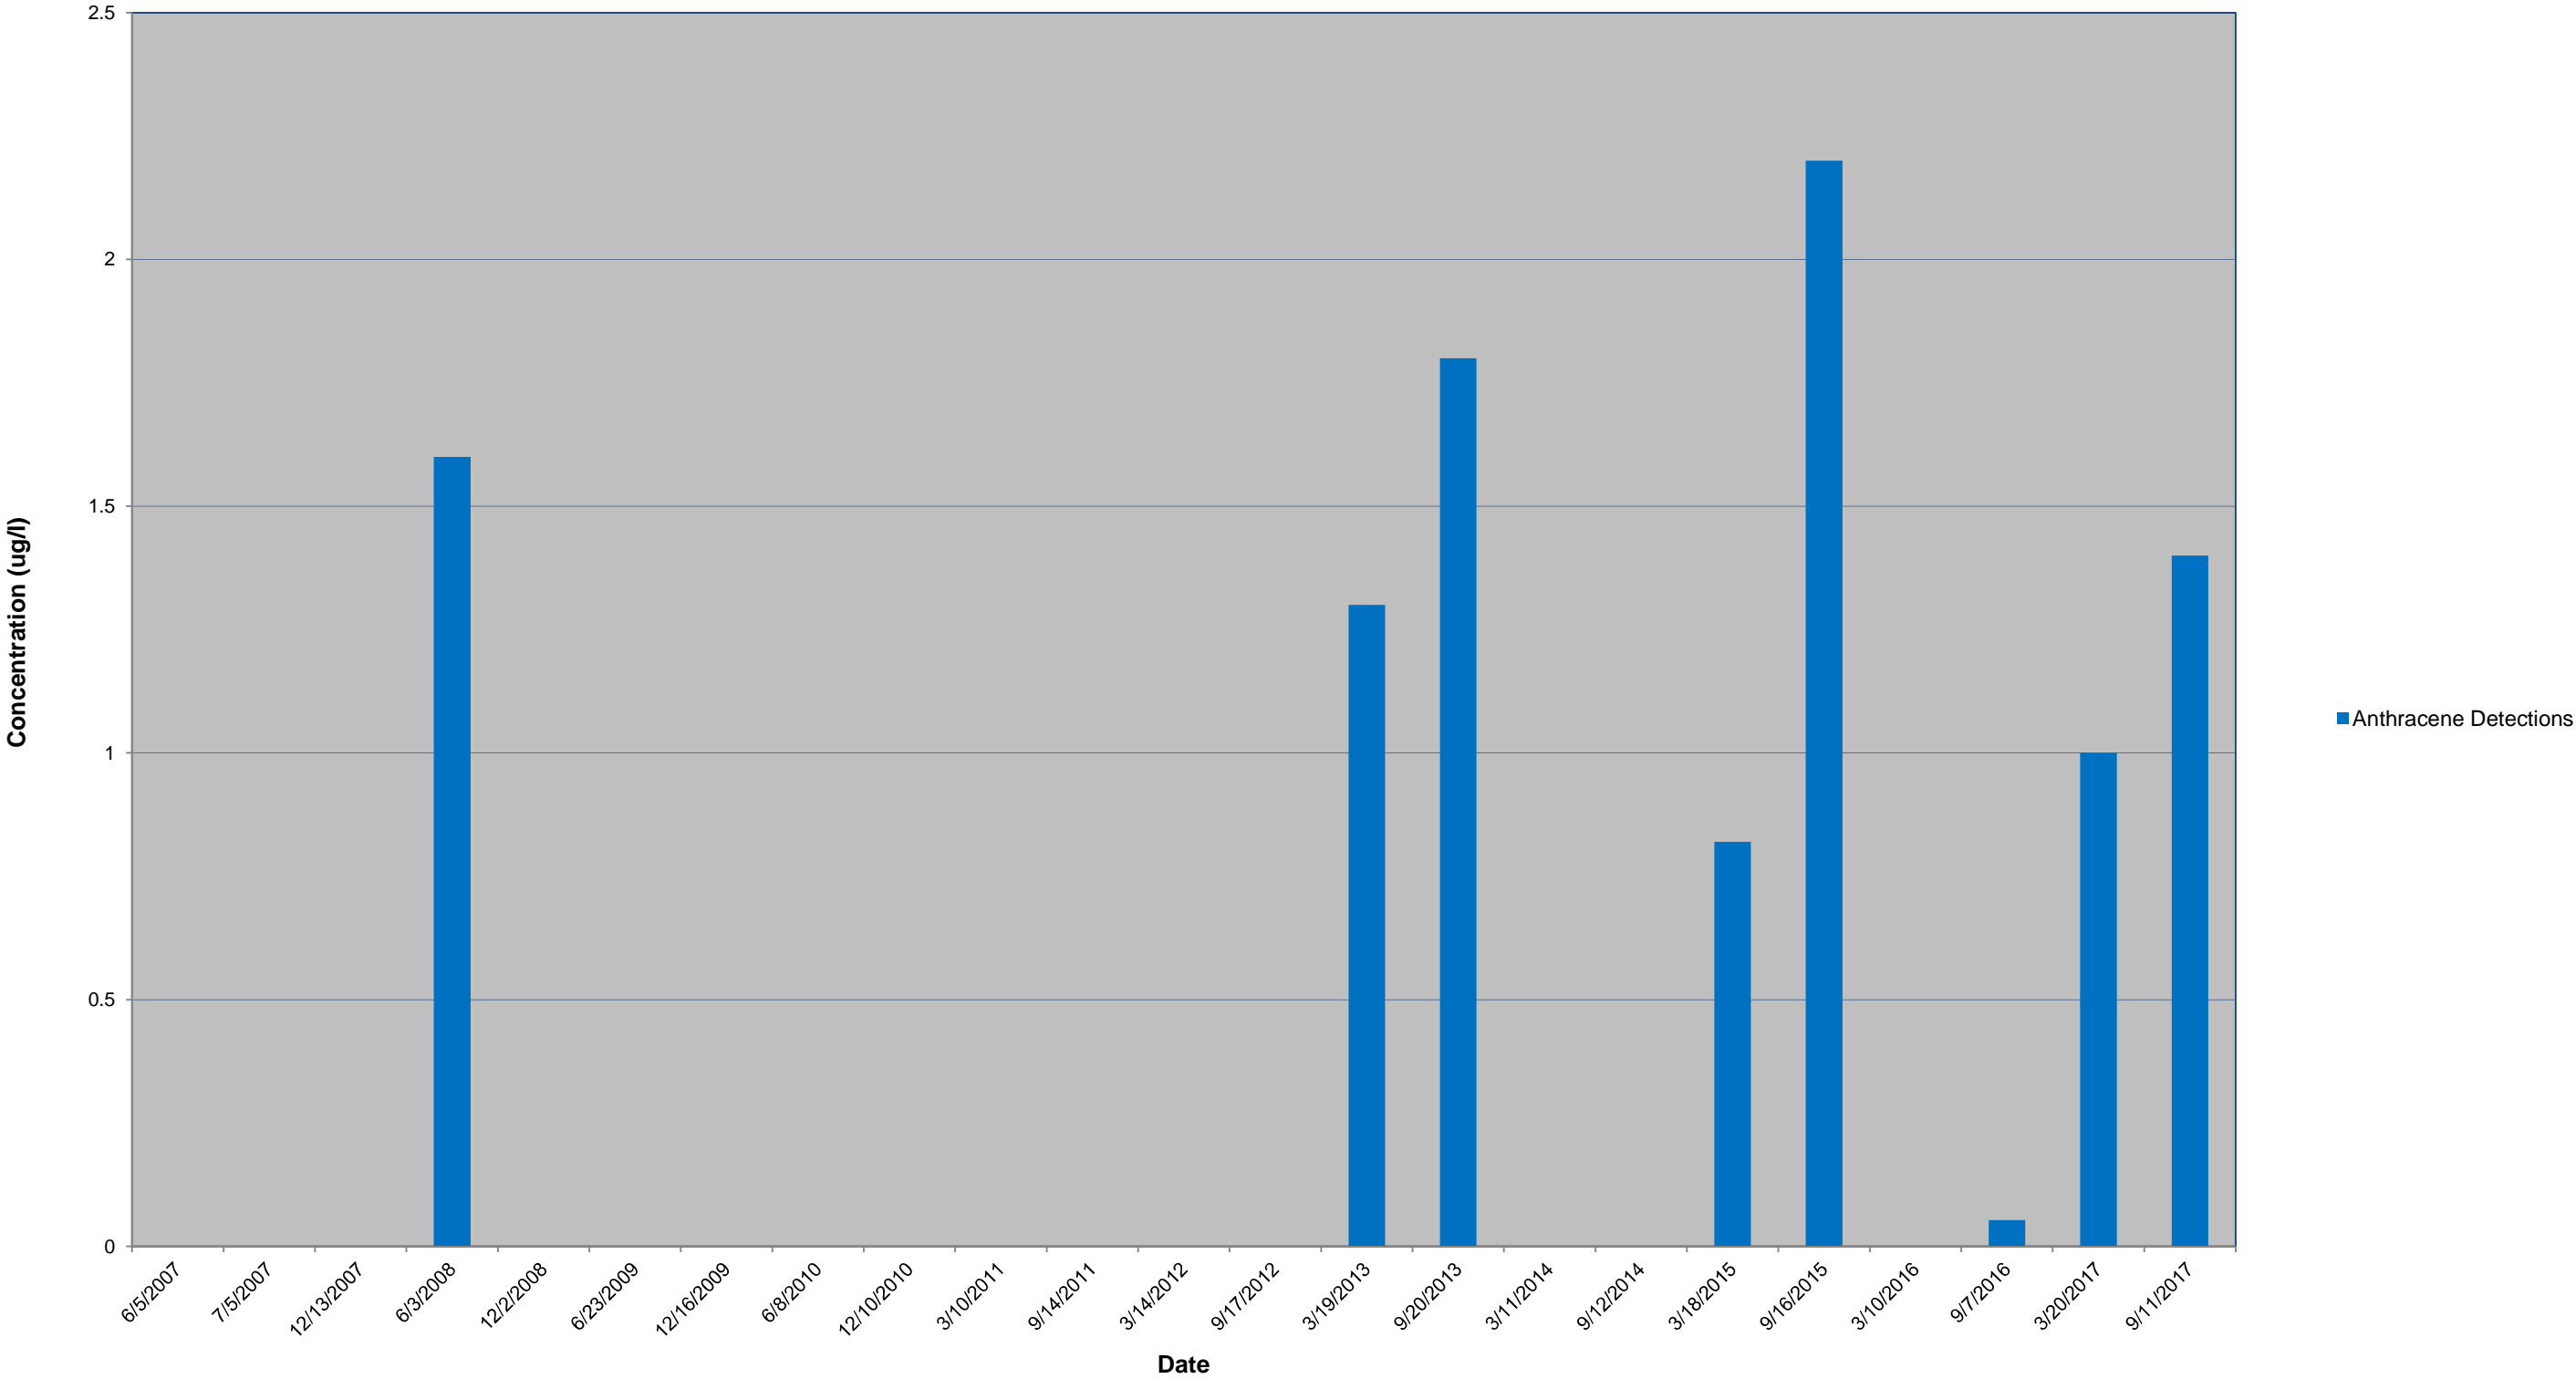


Carbazole Detections in CAMU Unit 1 Leak Detection Samples
2009-2017*

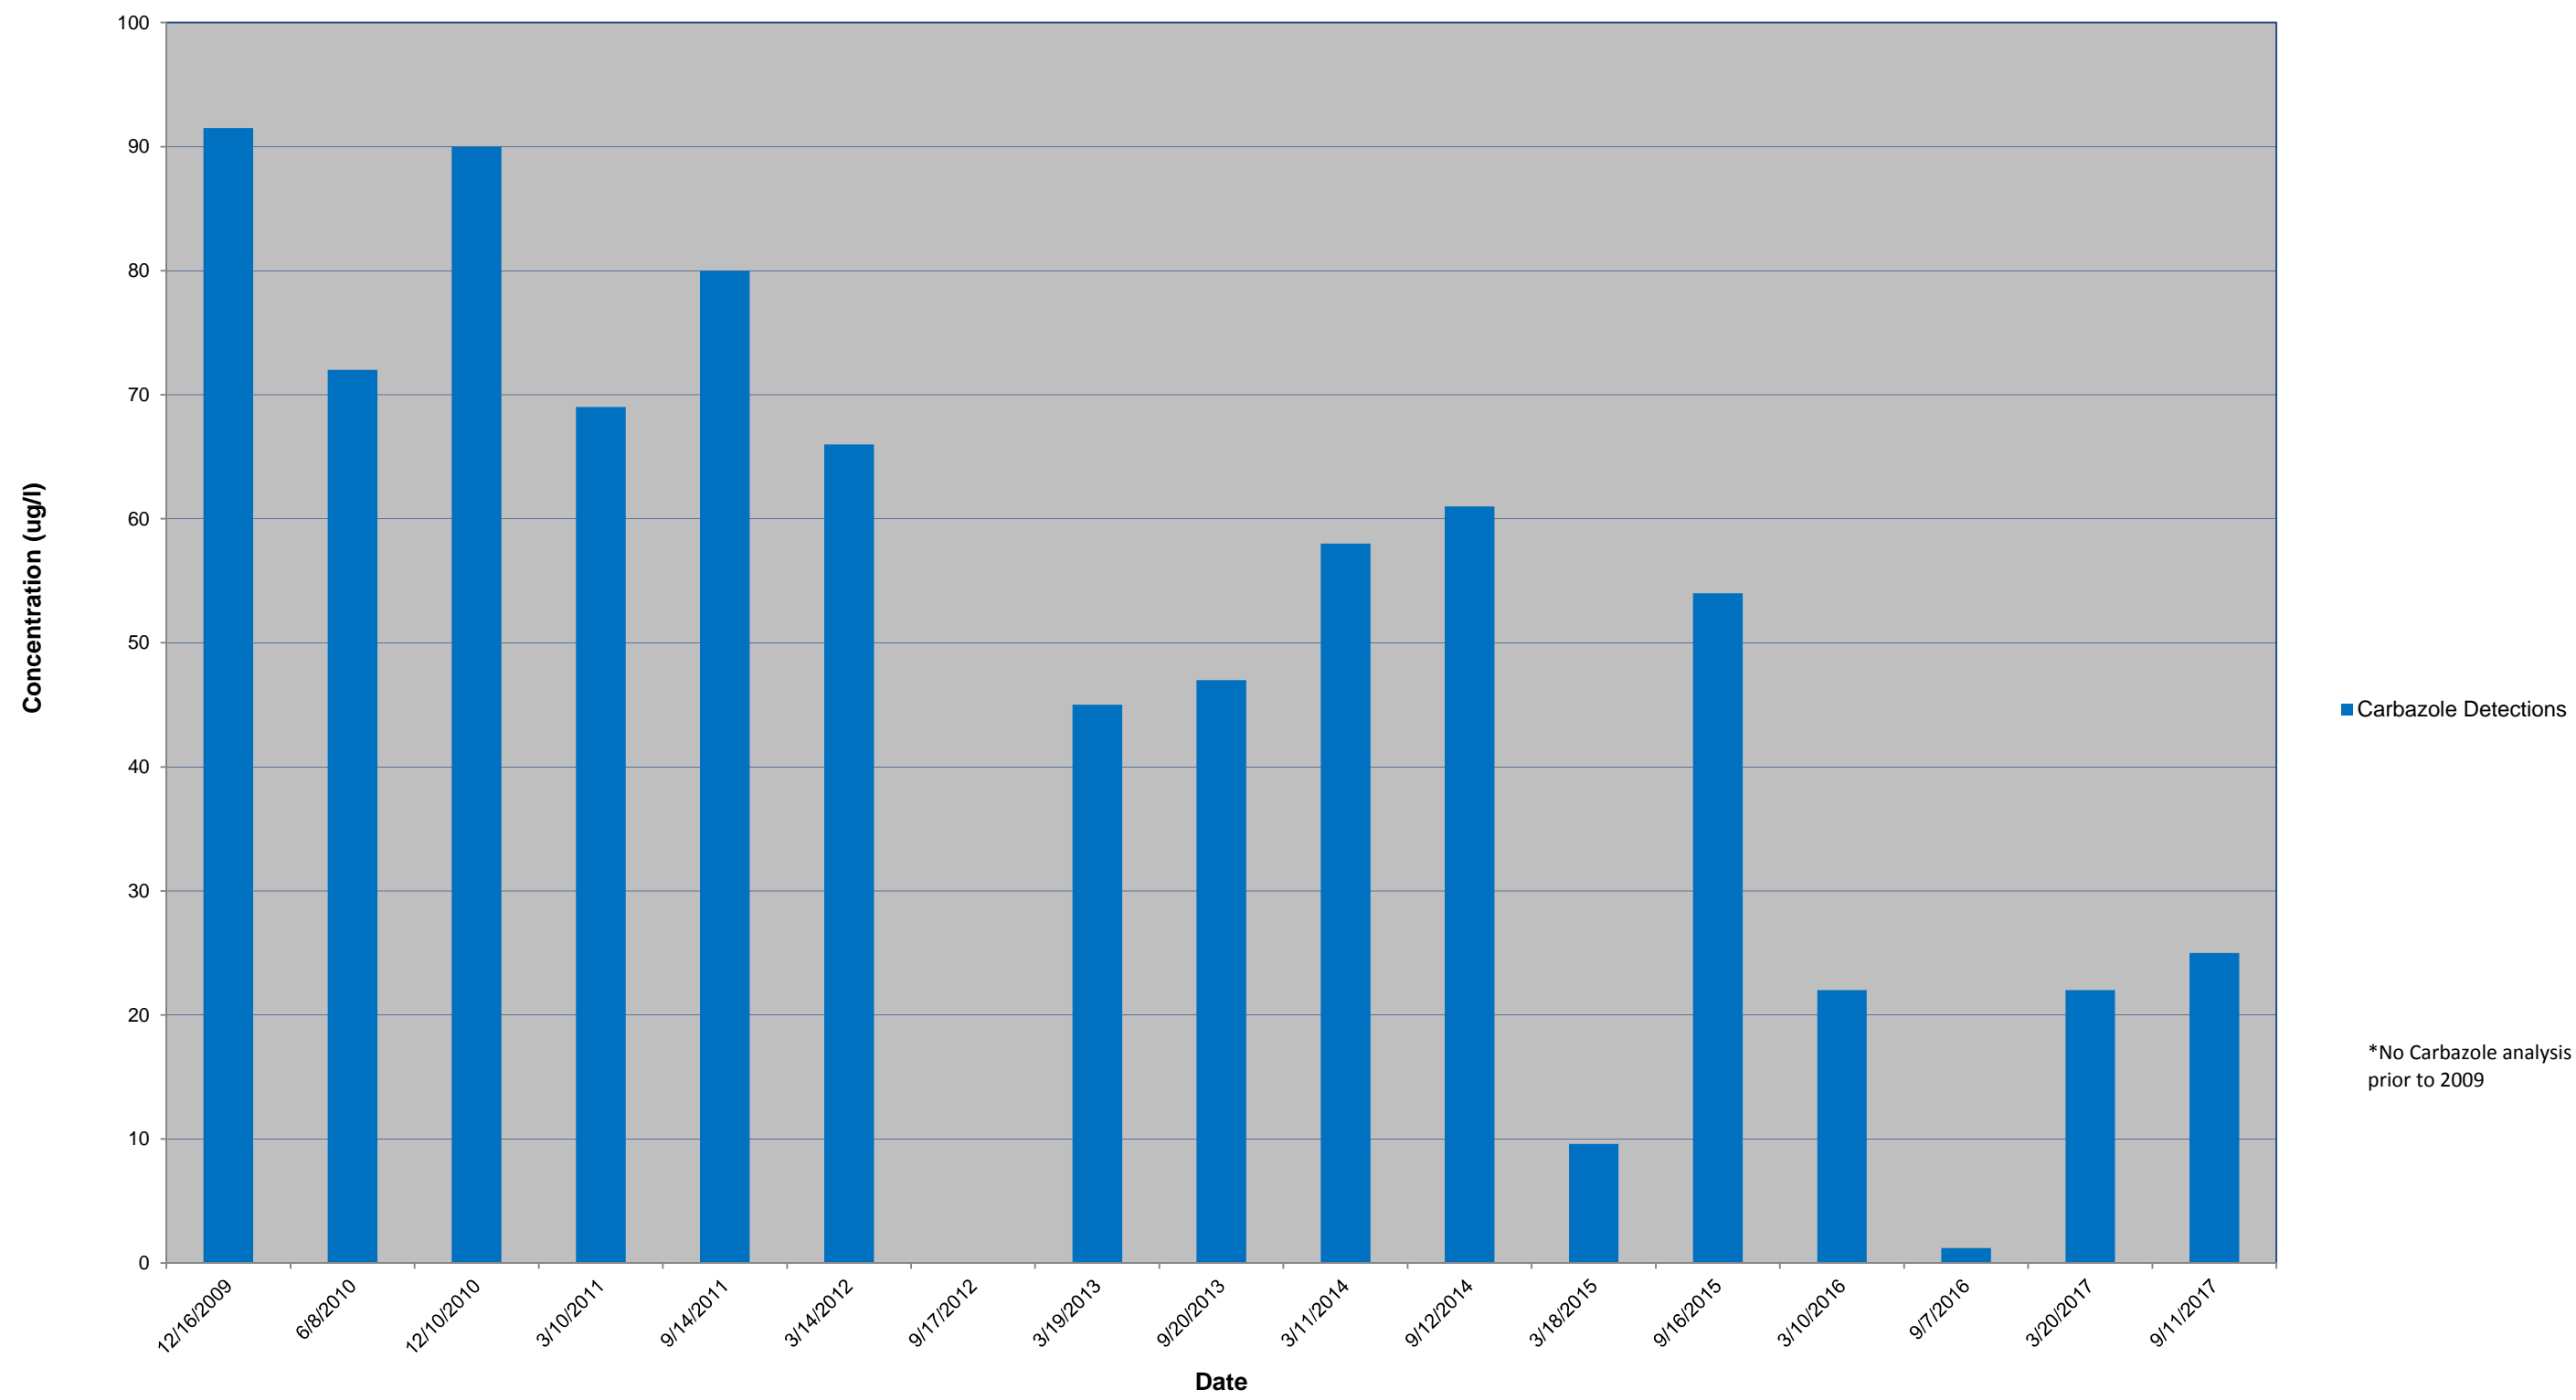


Dibenzofuran Detections in CAMU Unit 1 Leak Detection Samples
2007 - 2017

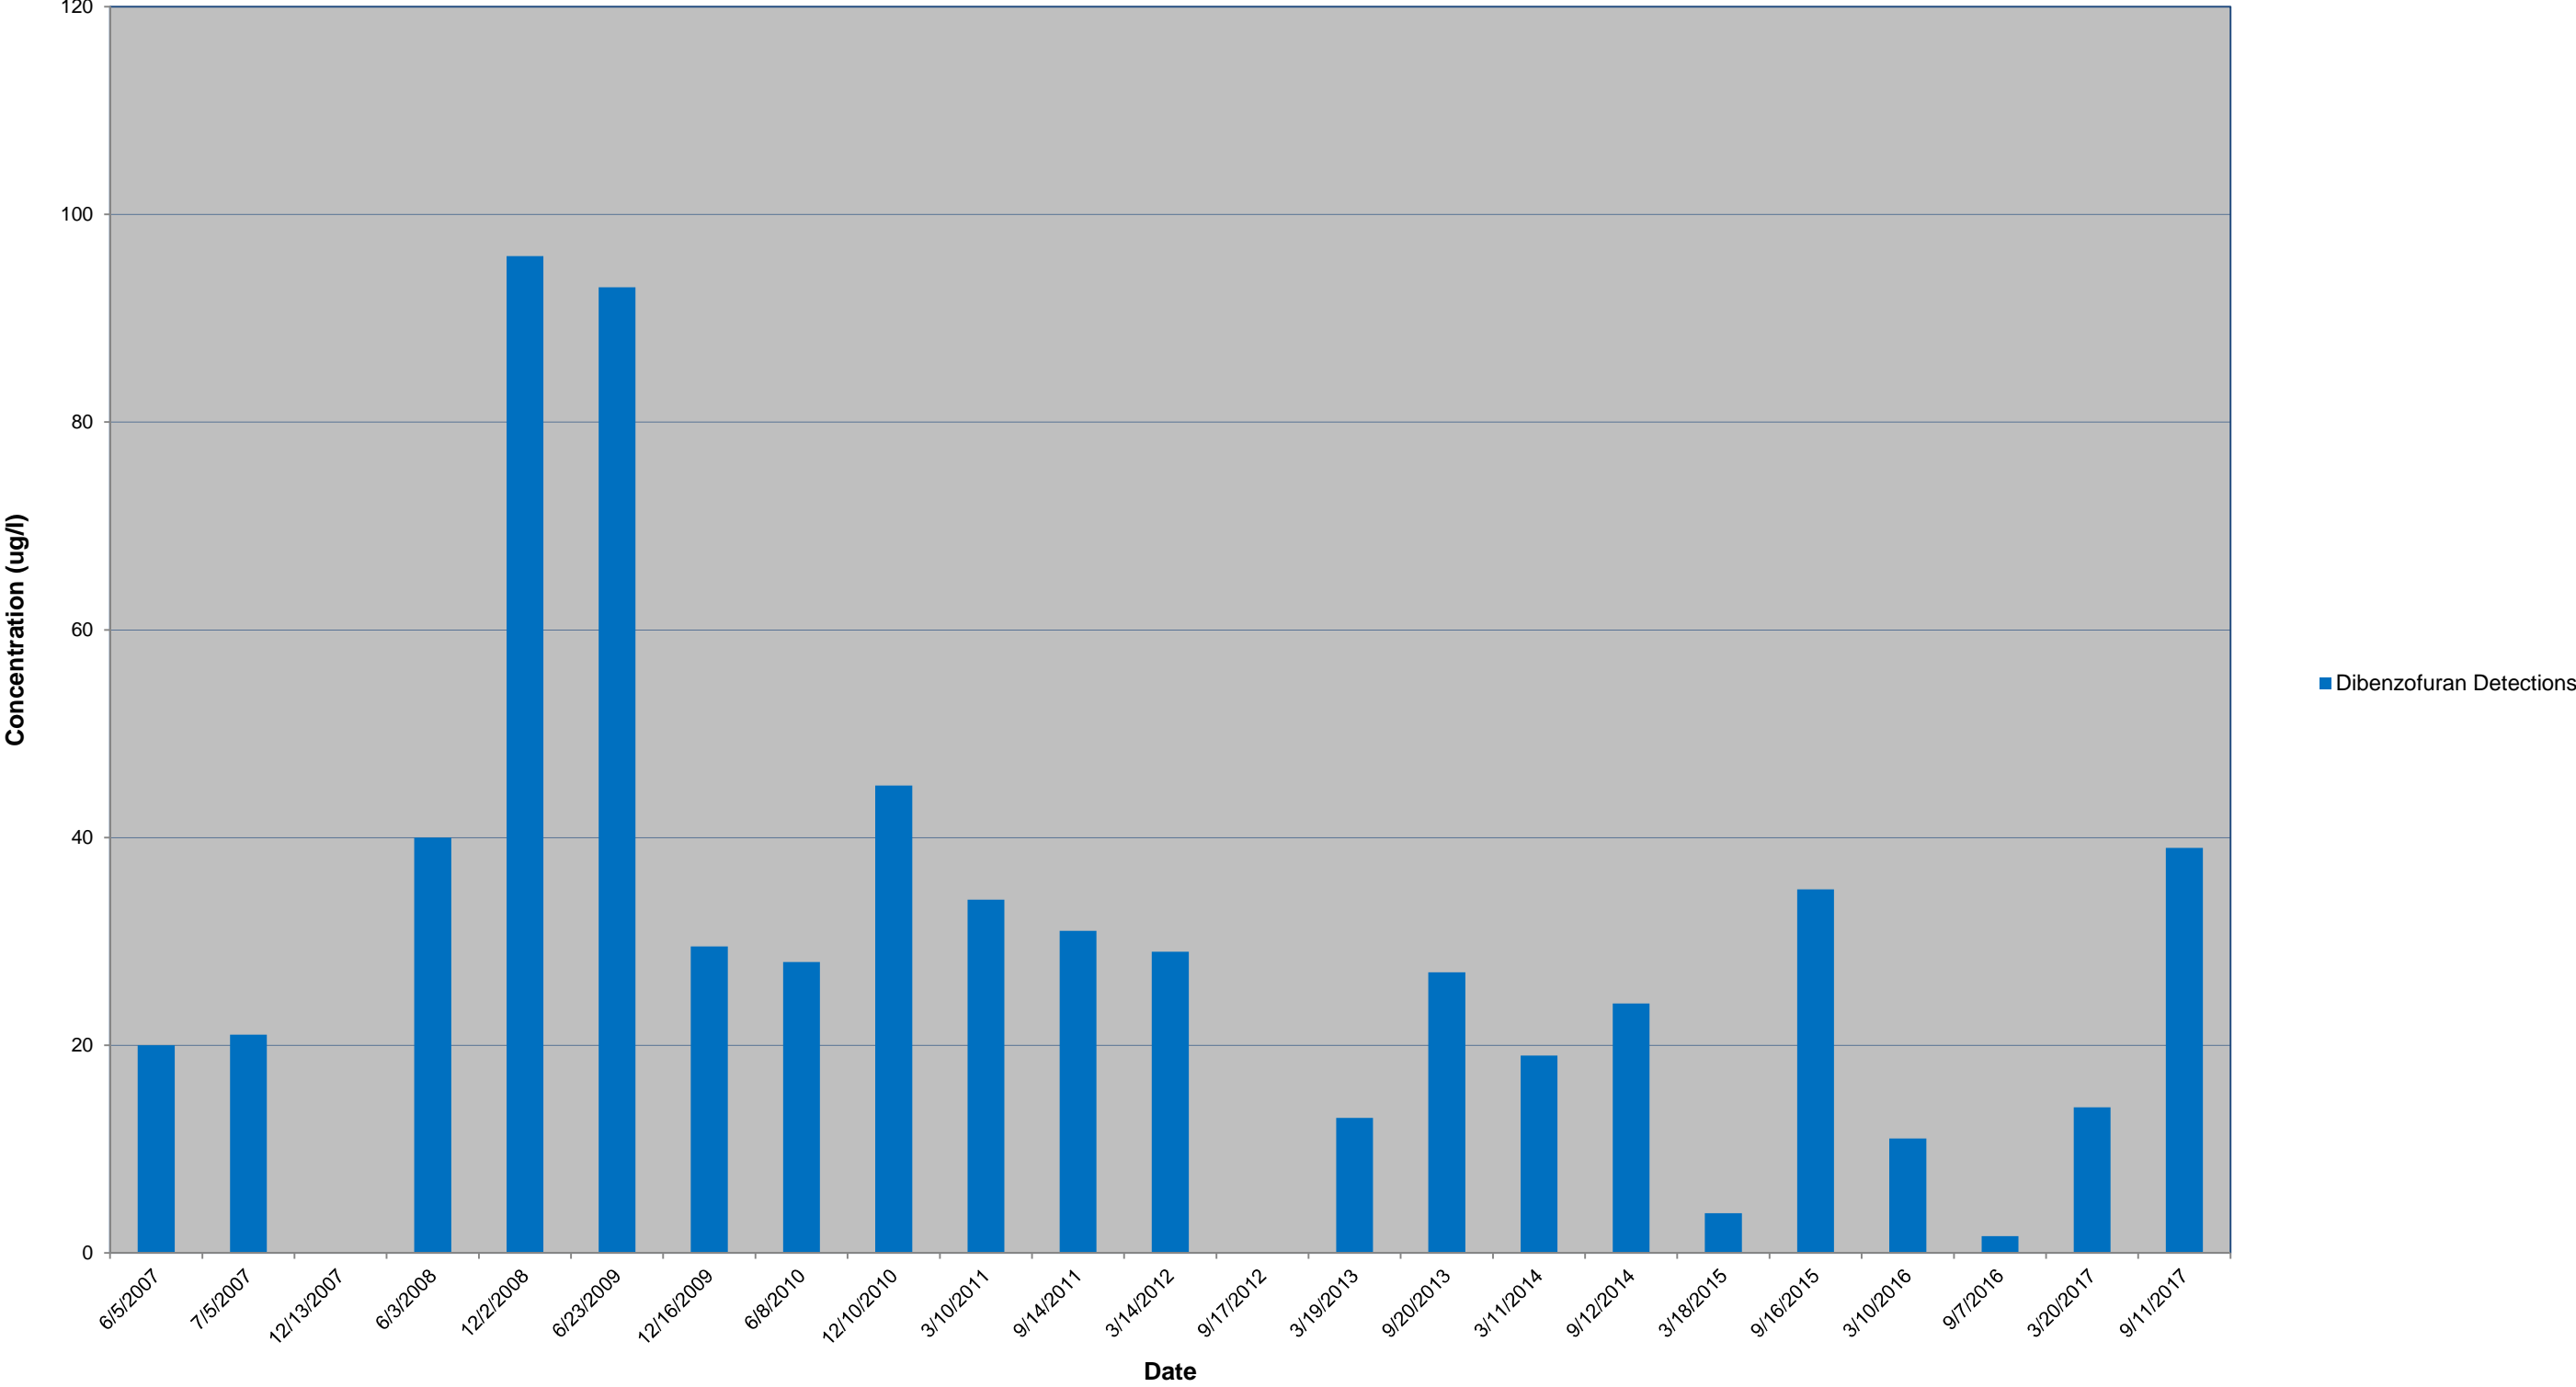


Fluoranthene Detections in CAMU Unit 1 Leak Detection Samples
2007 - 2017

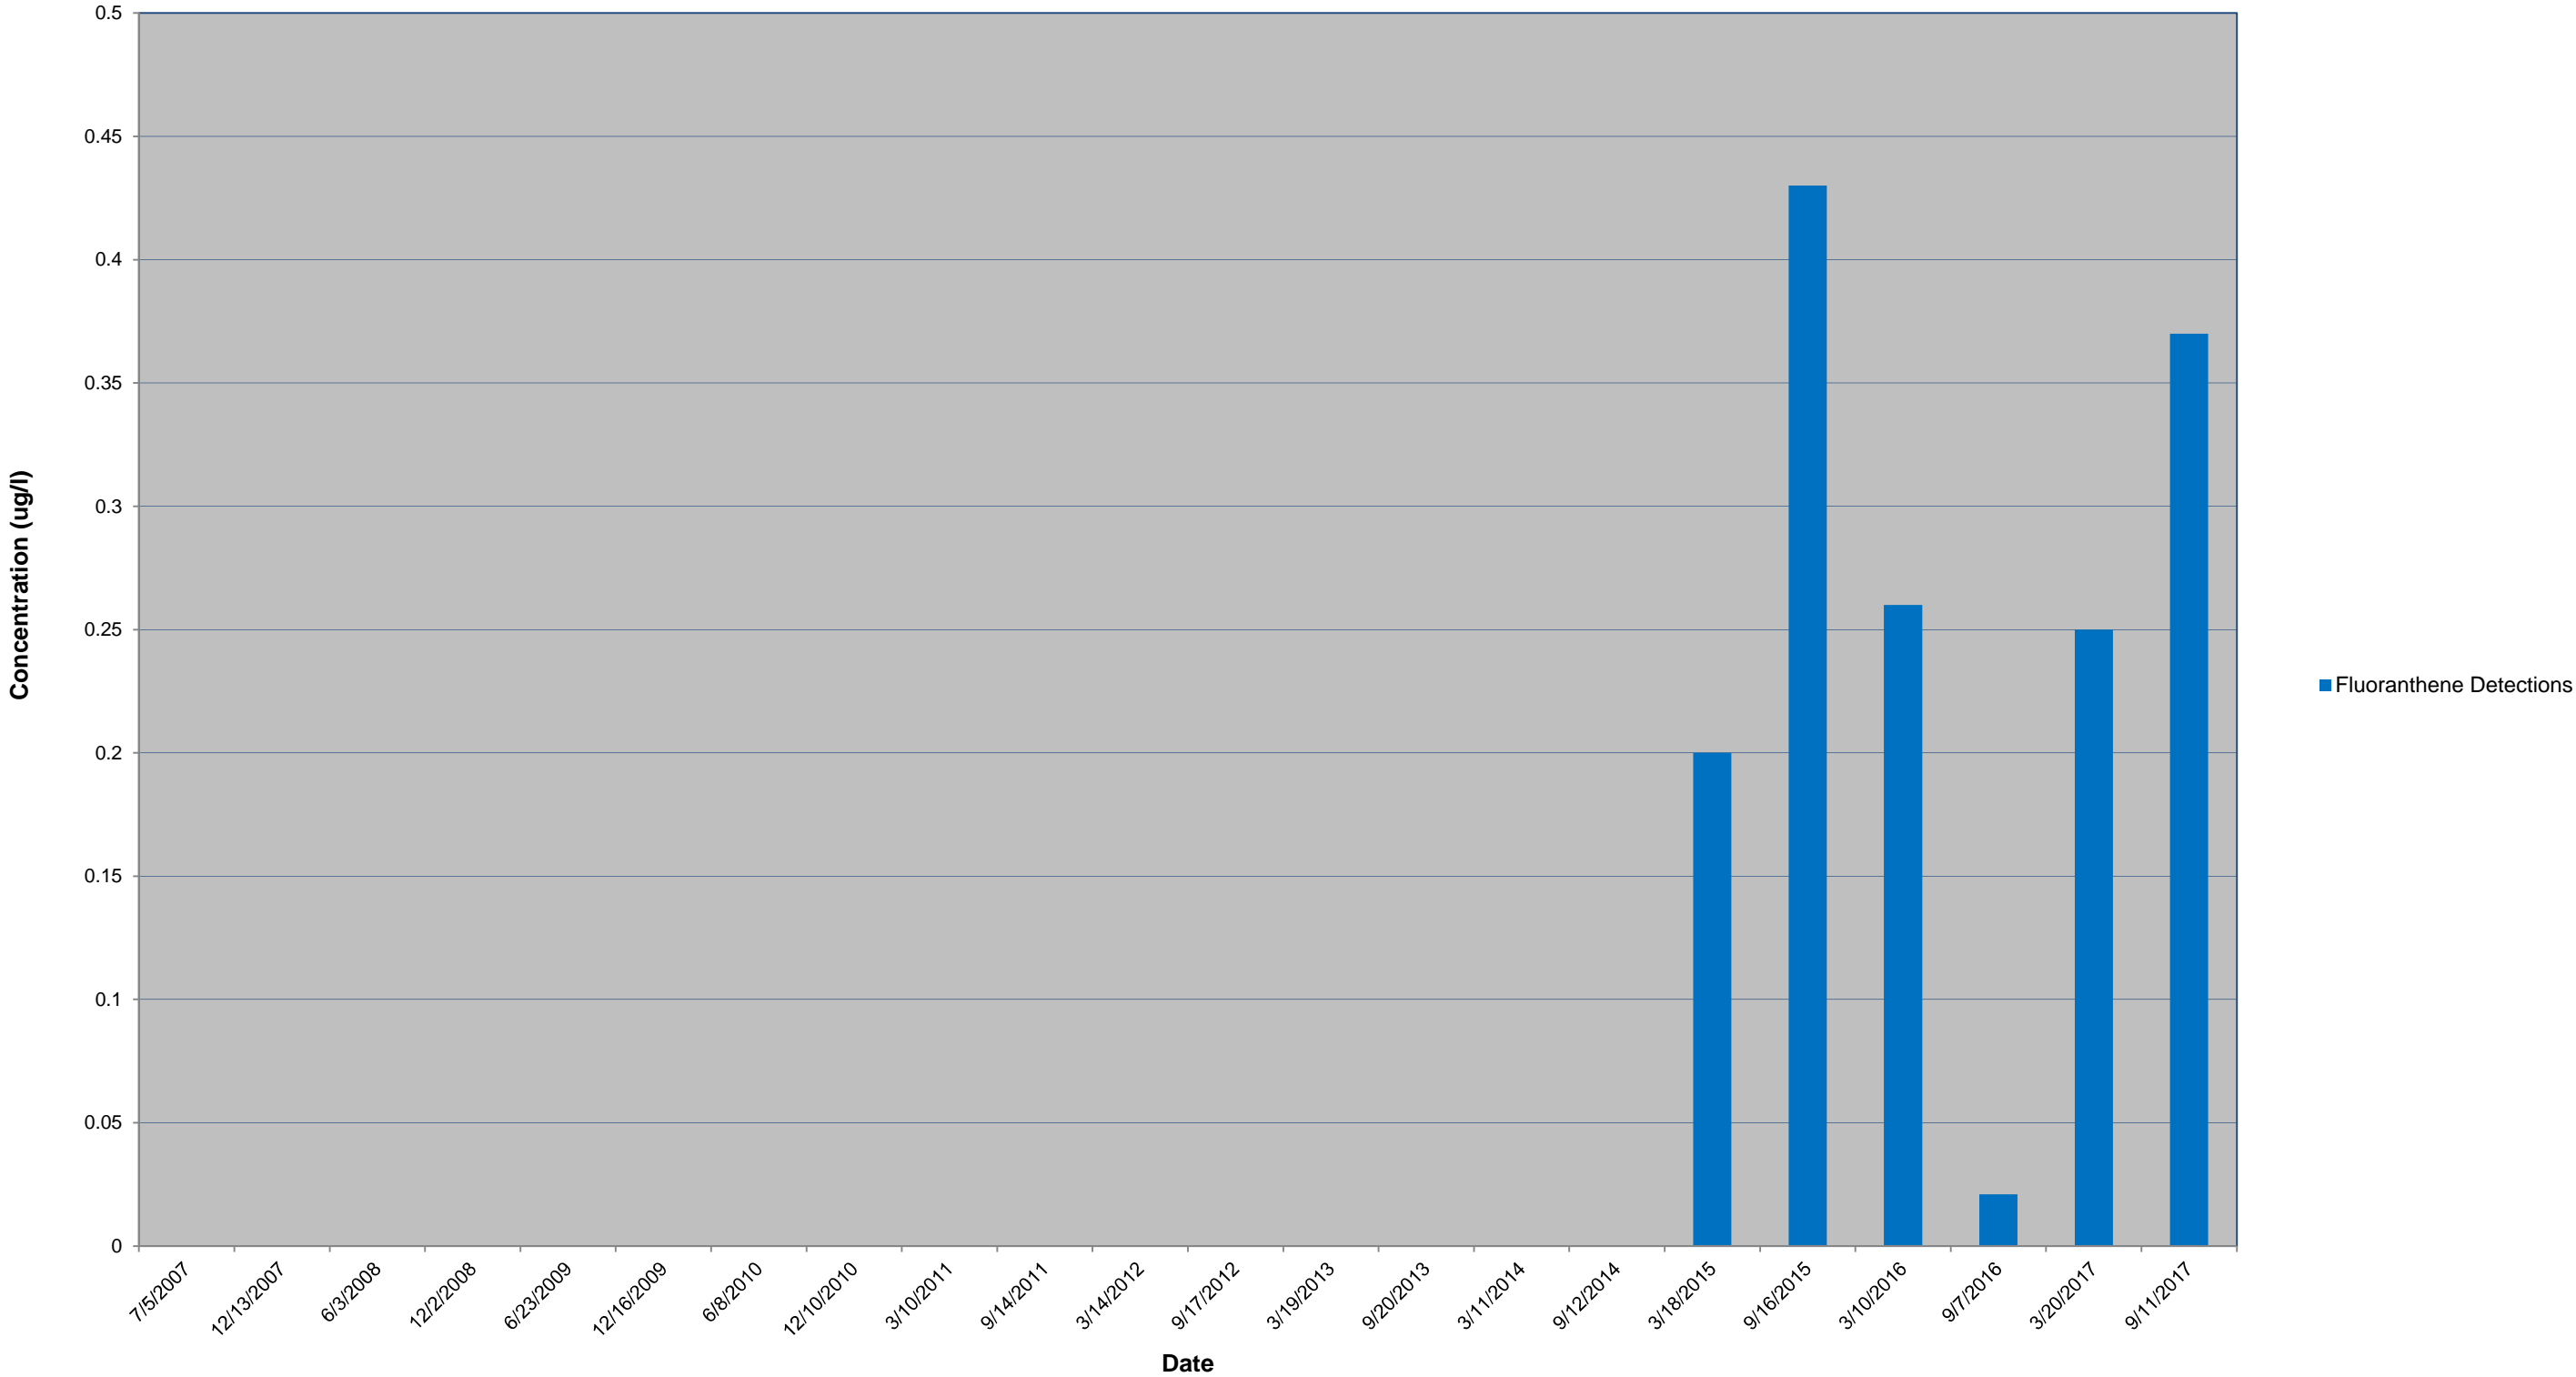


Fluorene Detections in CAMU Unit 1 Leak Detection Samples
2007 - 2017

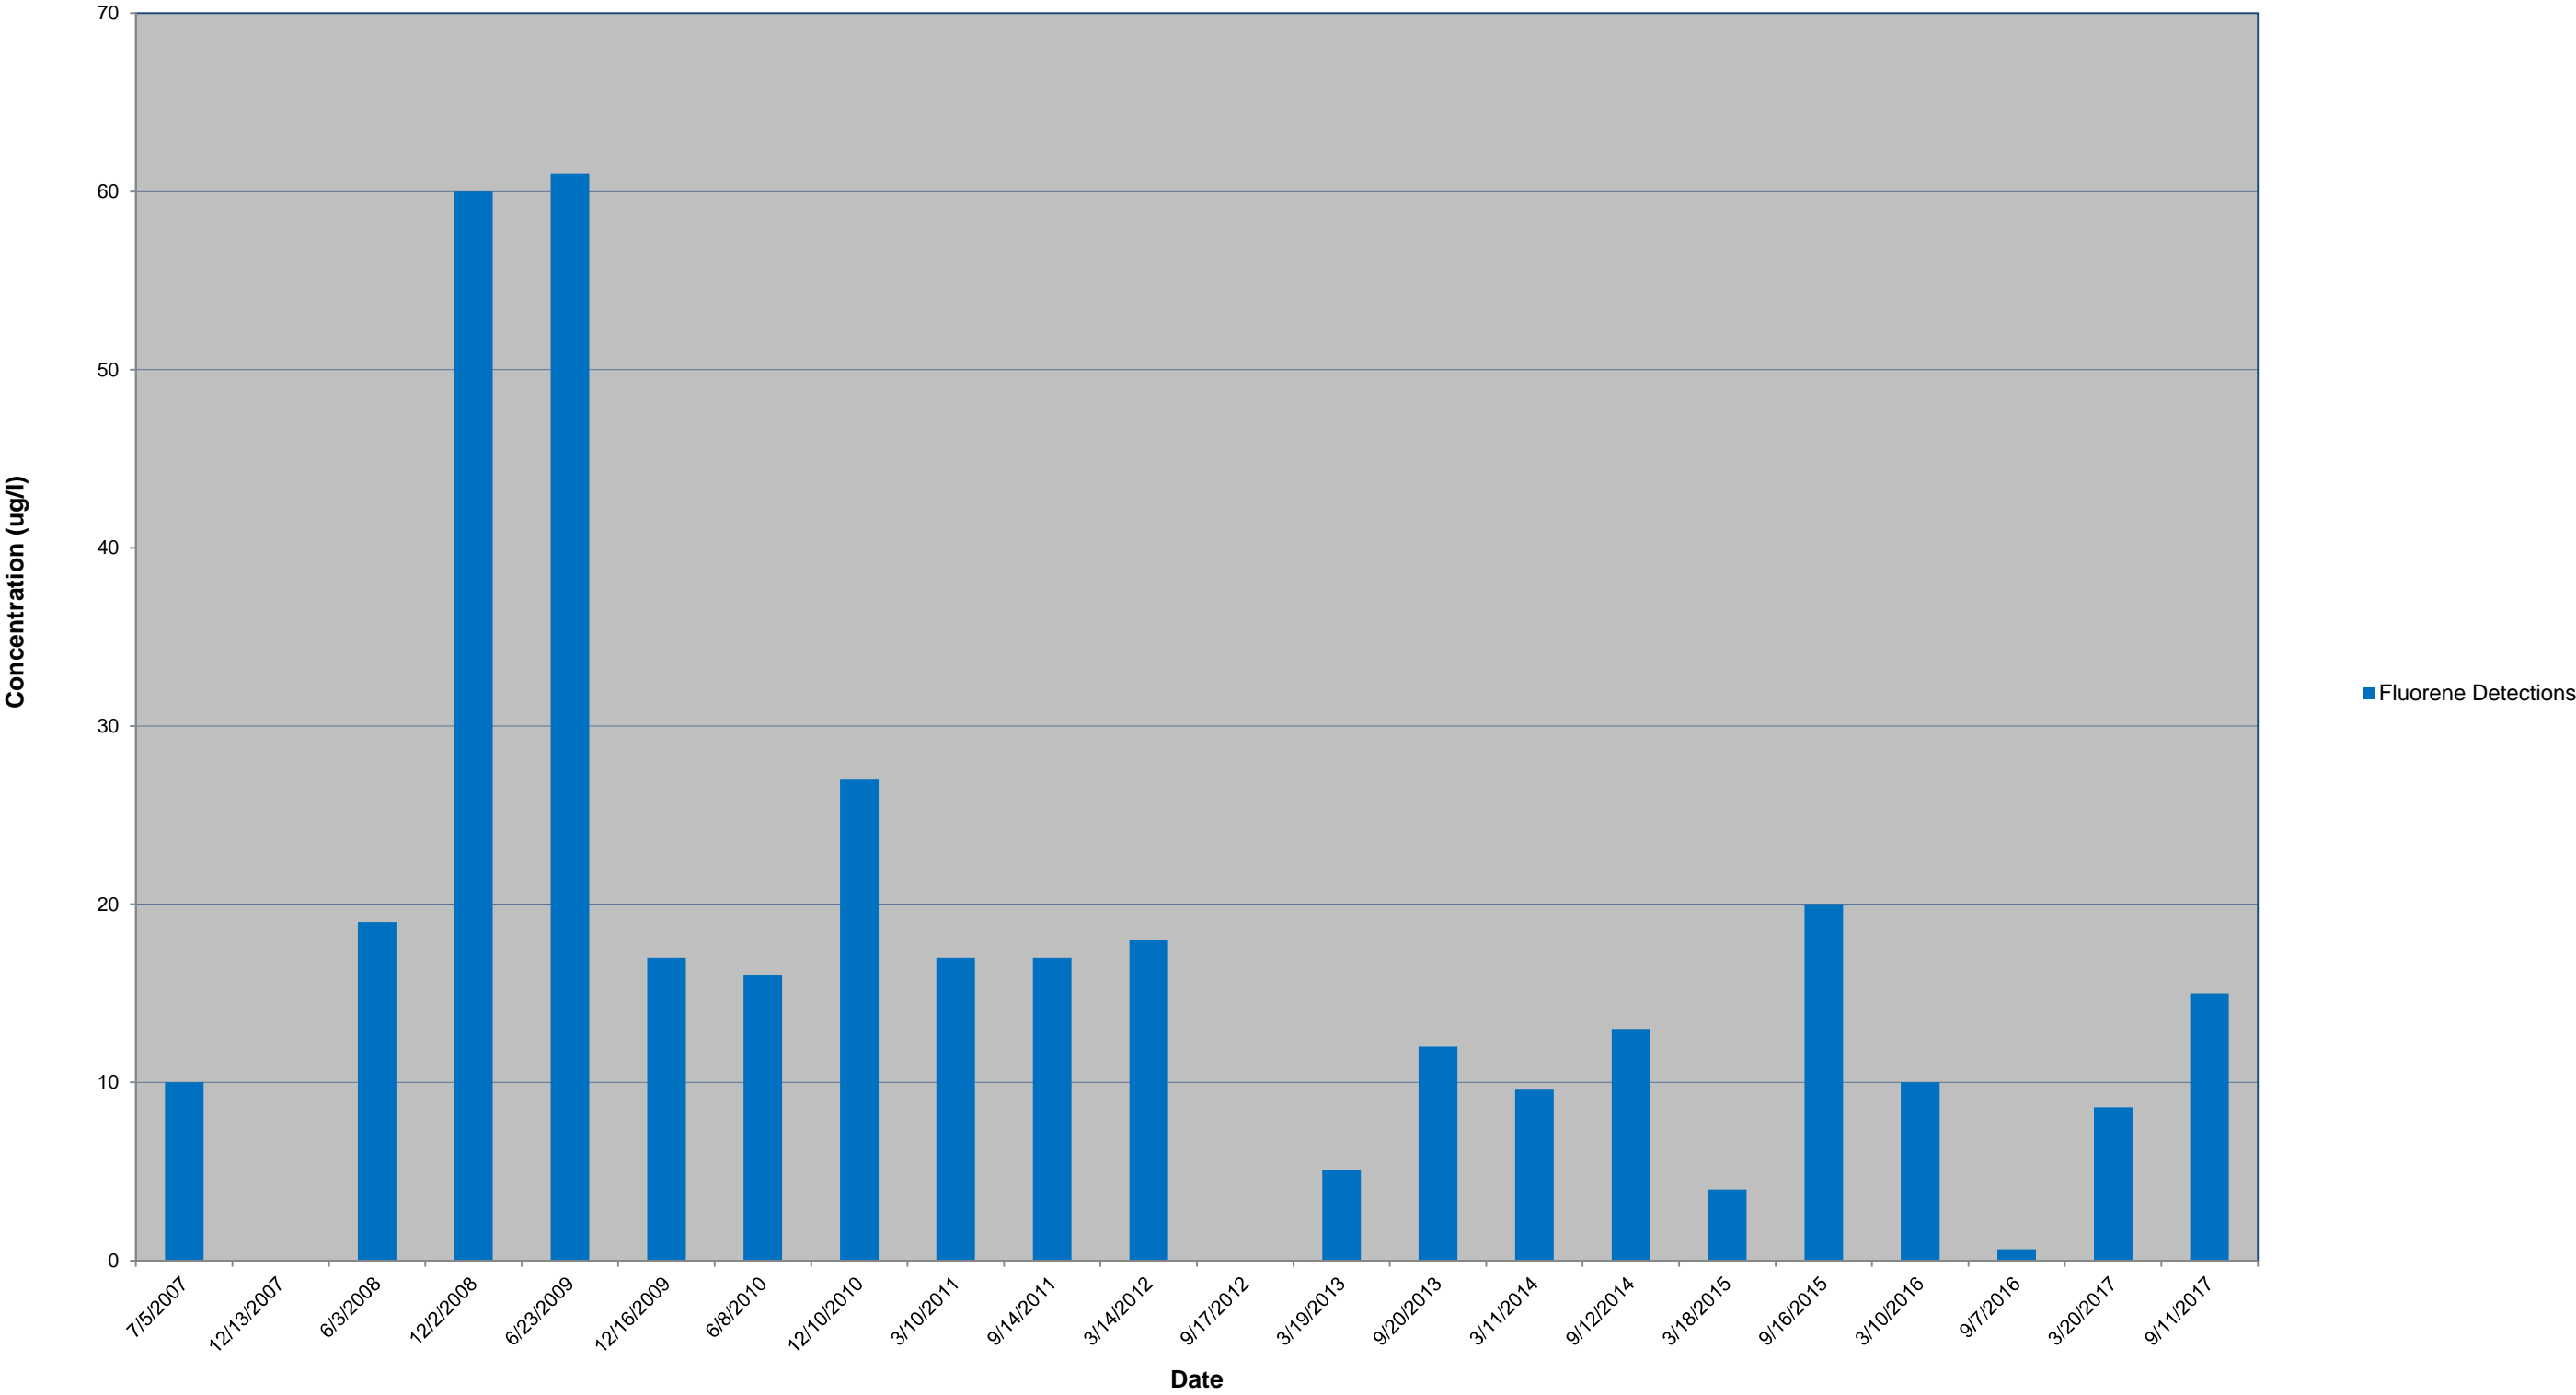


Naphthalene Detections in CAMU Unit 1 Leak Detection Samples
2007 - 2017

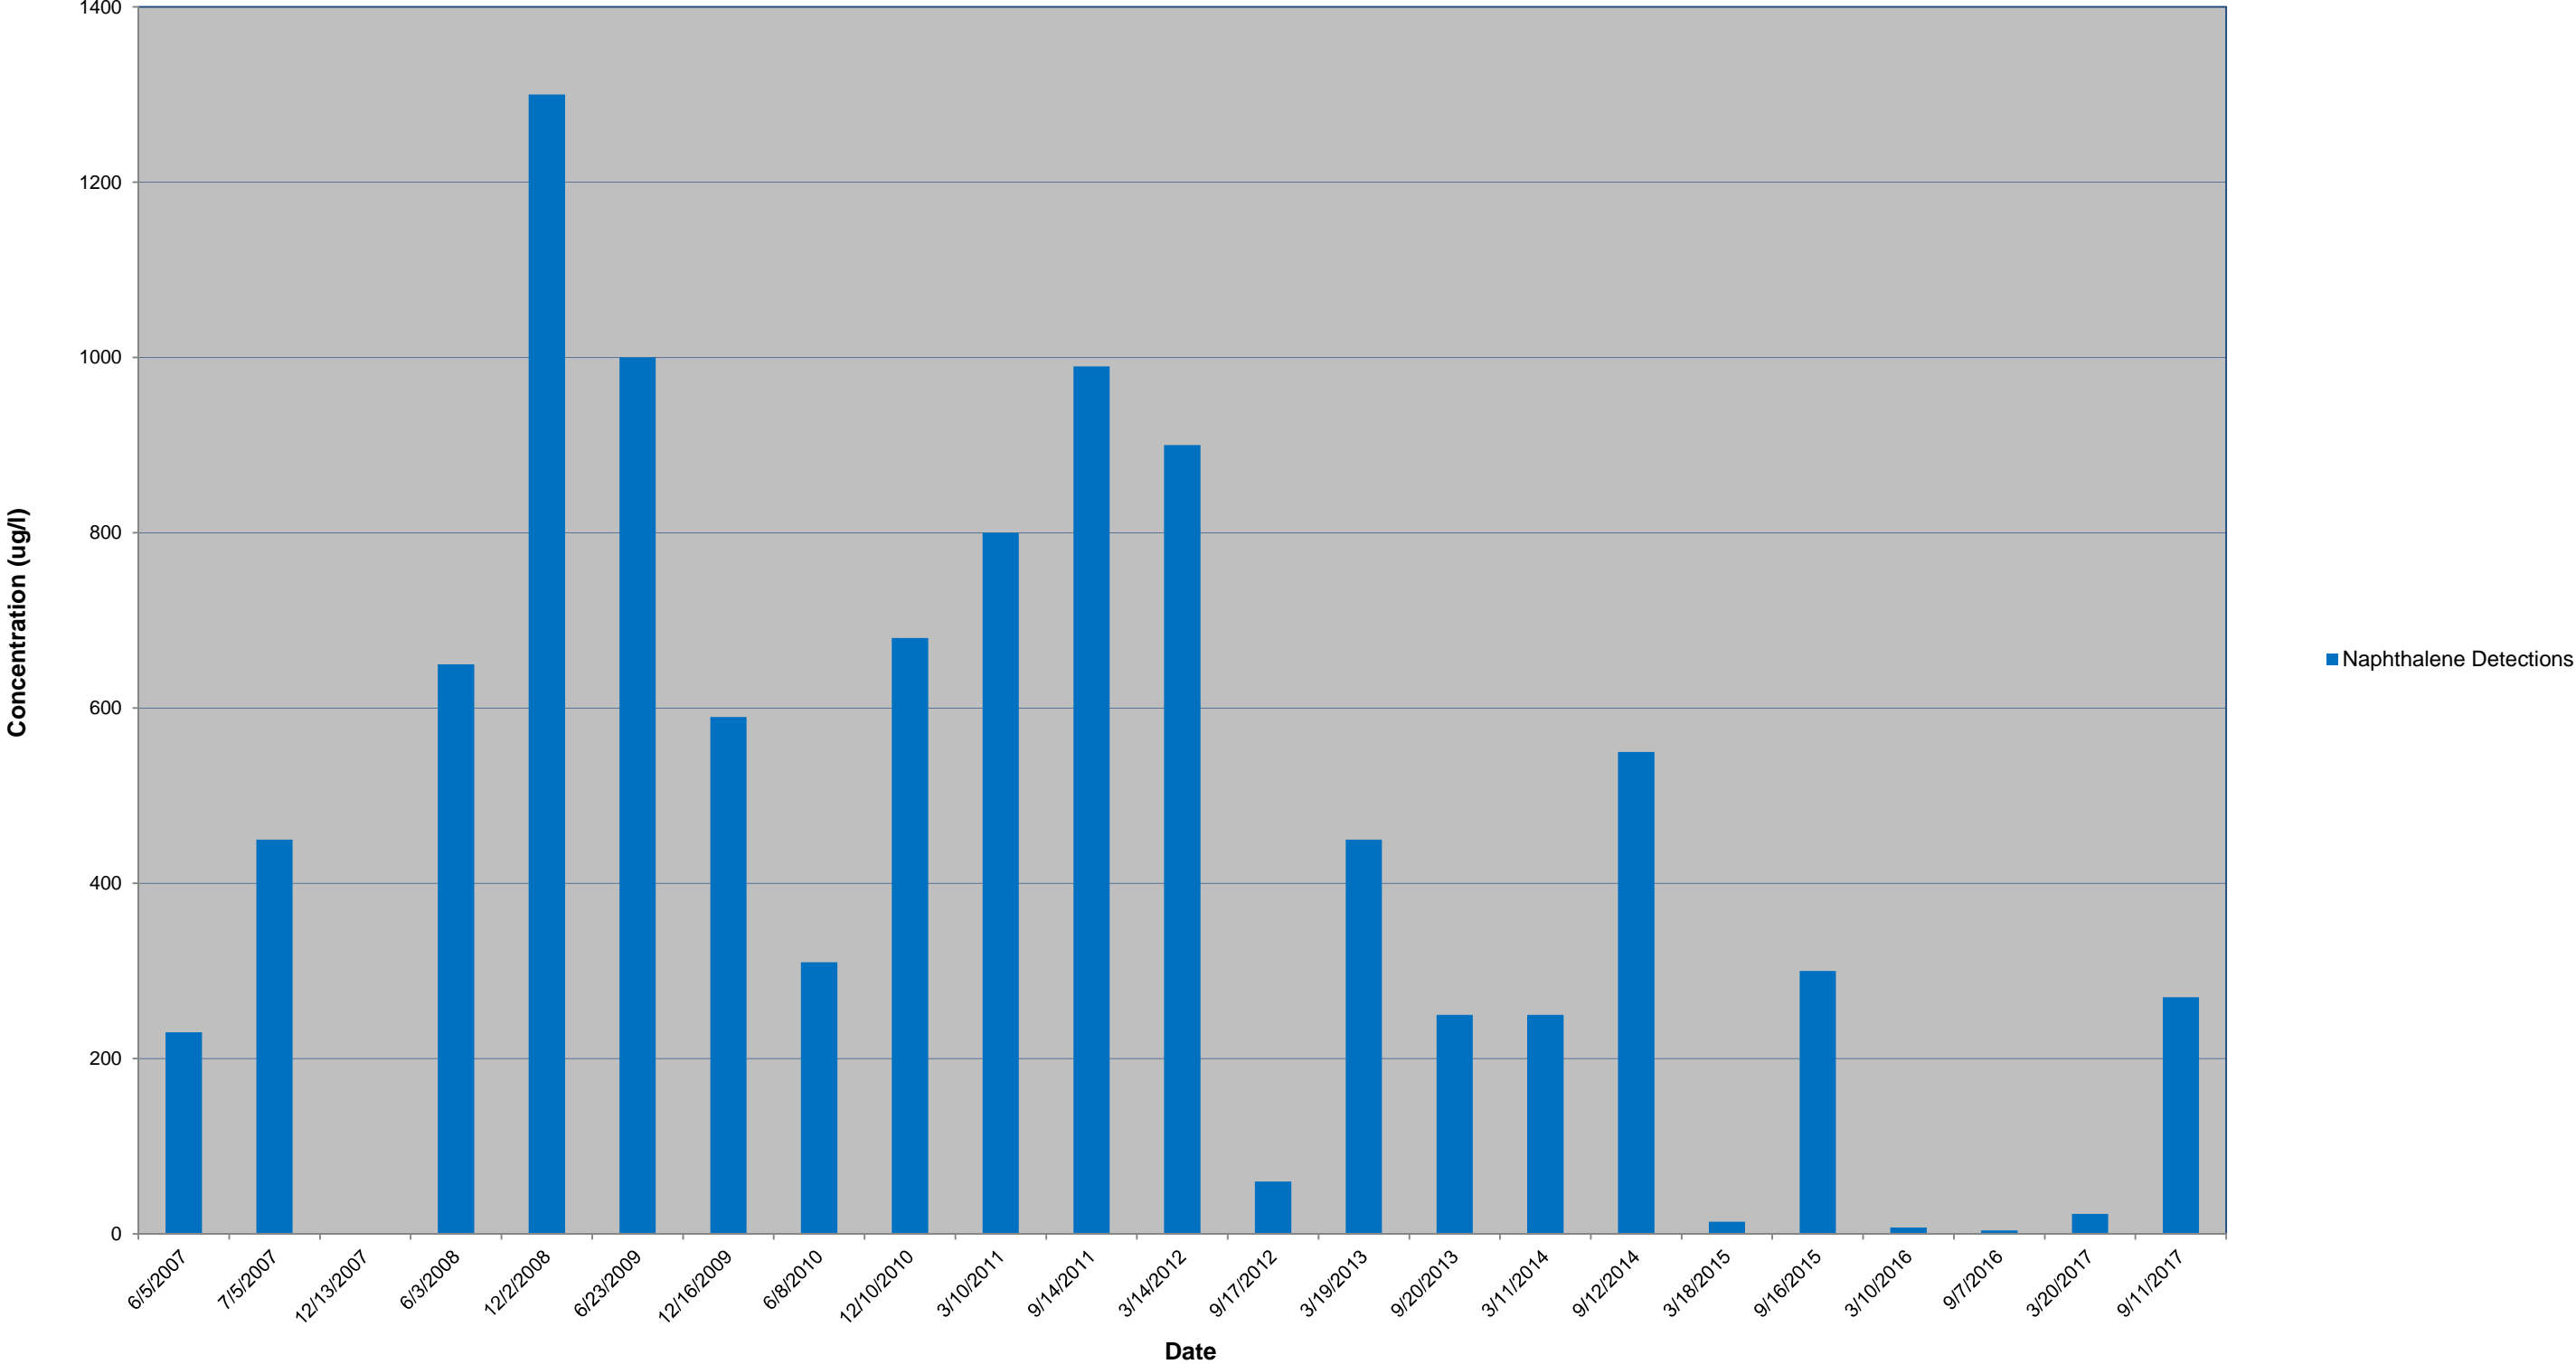

Phenanthrene Detections in CAMU Unit 1 Leak Detection Samples
2007 - 2017

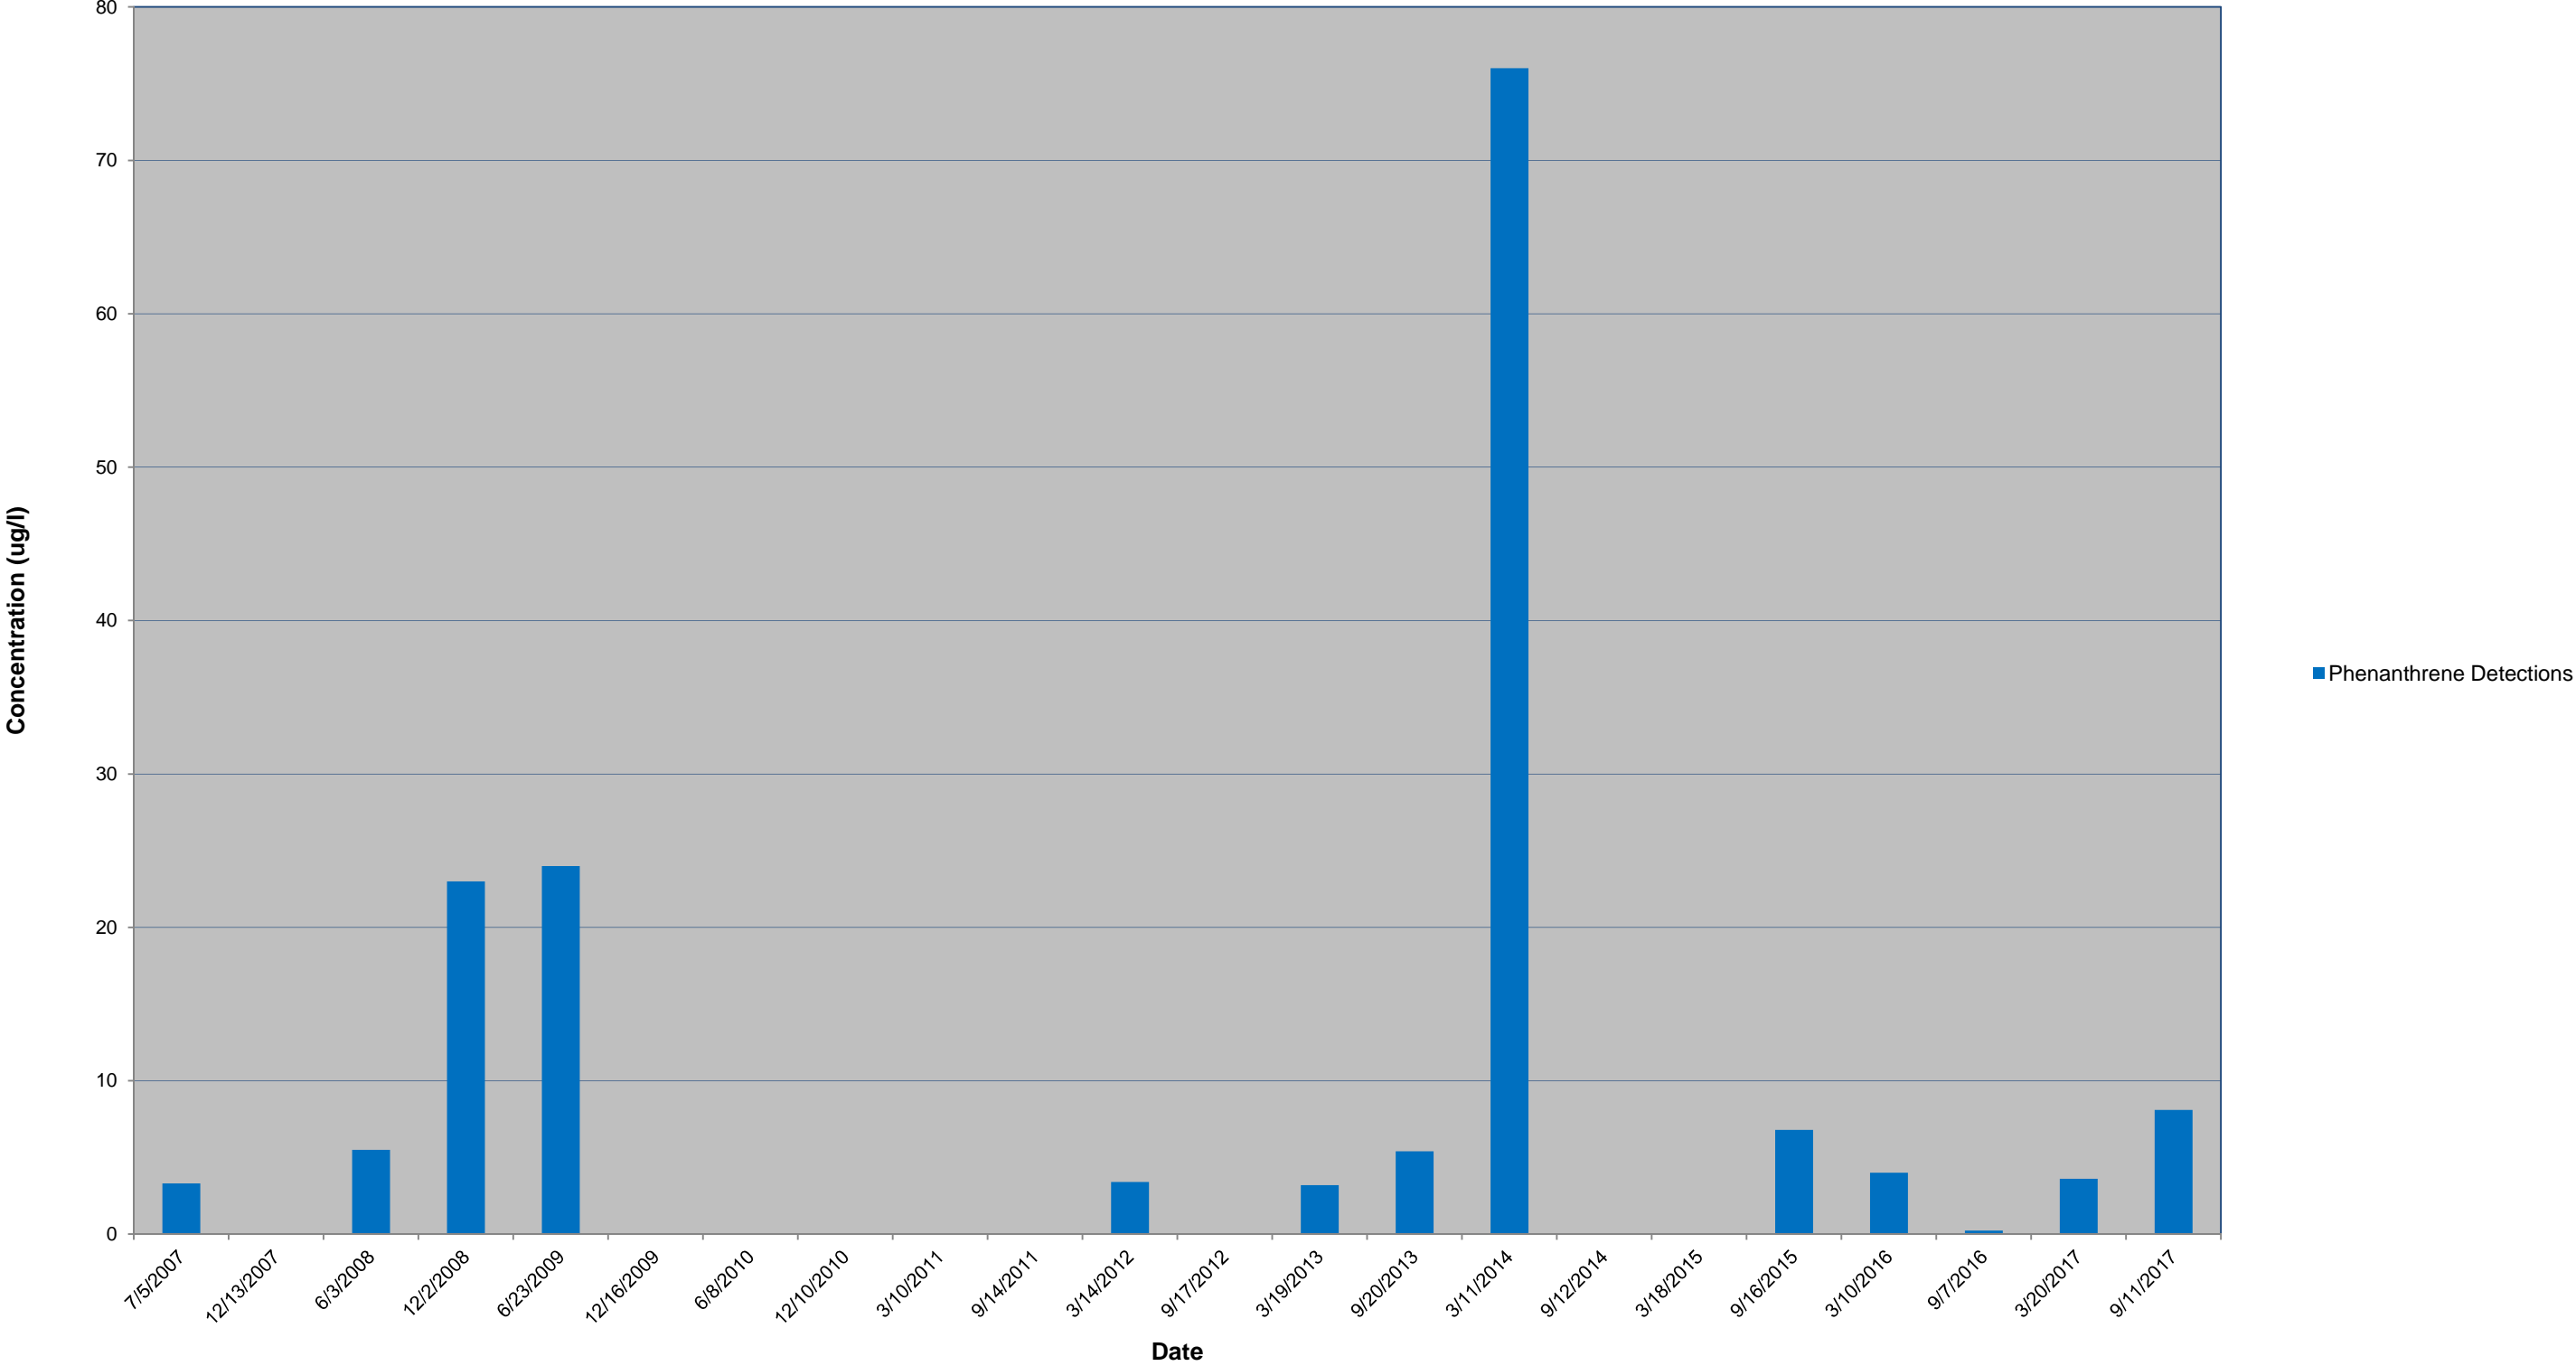

Phenol Detections in CAMU Unit 1 Leak Detection Samples
2007 - 2017

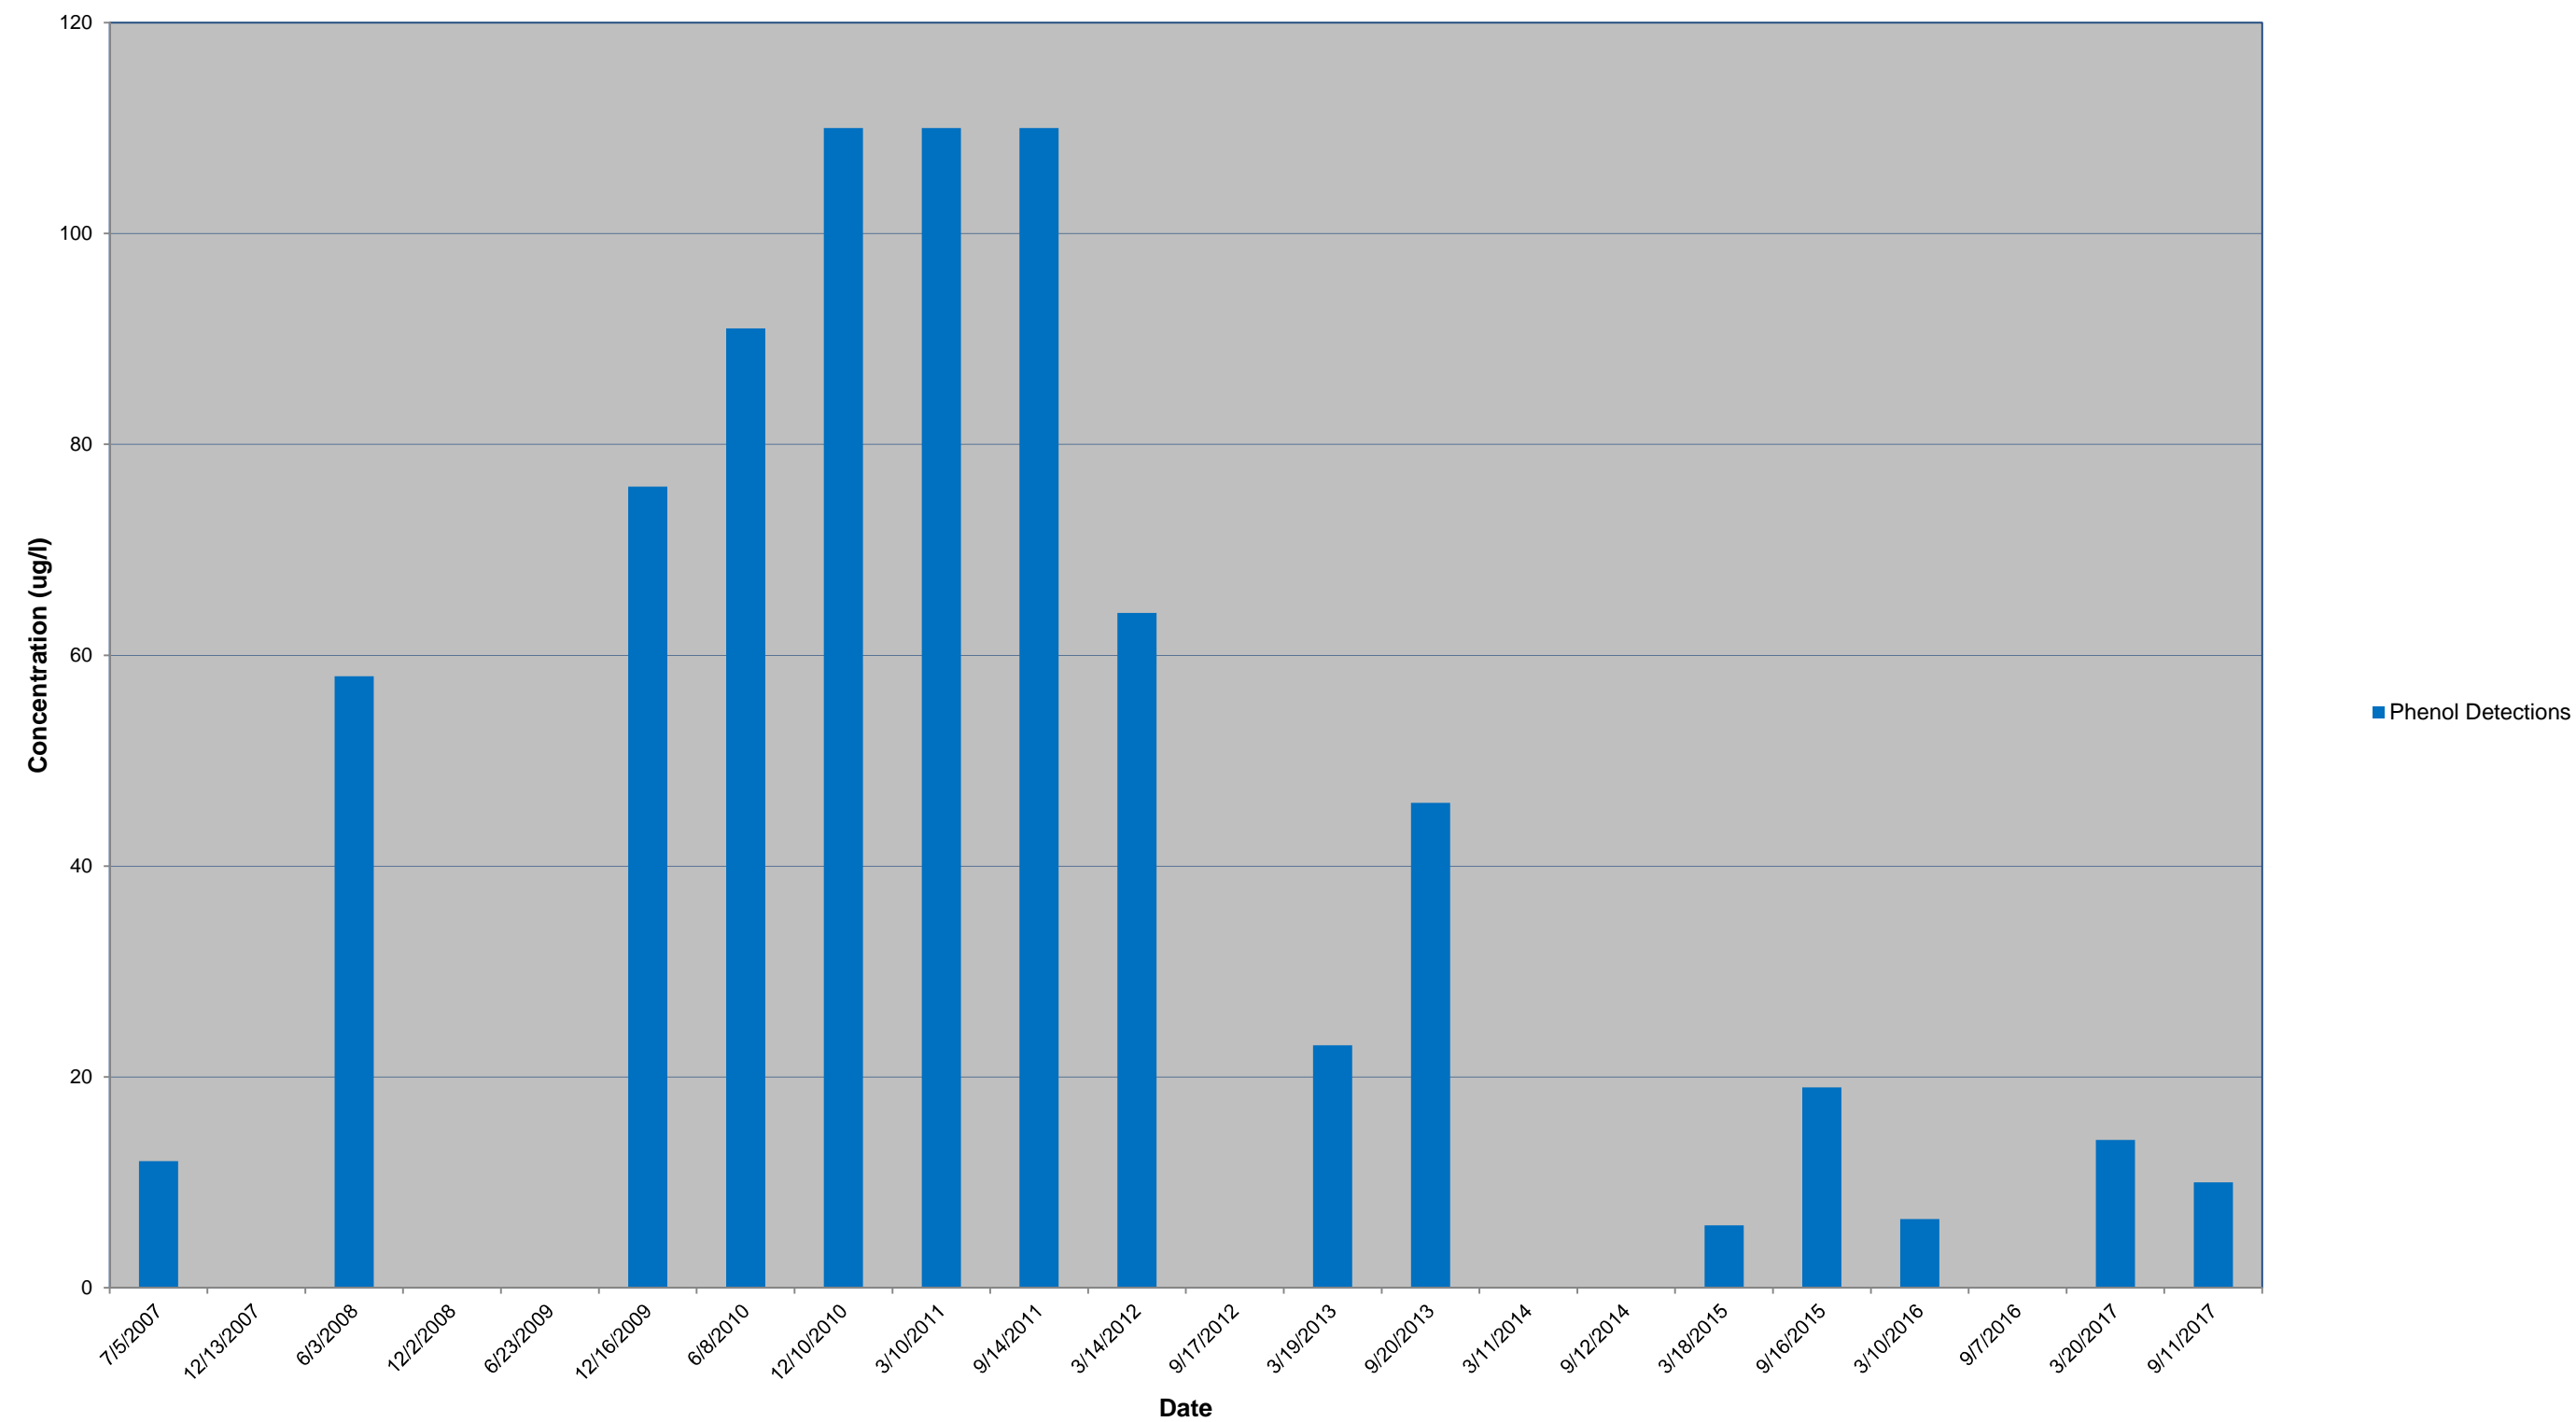

Pyrenel Detections in CAMU Unit 1 Leak Detection Samples
2007 - 2017

